



BS 4504 : Section 3.1 : 1989

UDC 621.643.4 - 034.14 : 669.13 : 669.35 : 621.643.411.412.8 :
001.4 : 006.3/8

© British Standards Institution. No part of this publication may be photocopied or otherwise reproduced without the prior permission in writing of BSI

British Standard

Circular flanges for pipes, valves and fittings (PN designated)

Part 3. Steel, cast iron and copper alloy flanges

Section 3.1 Specification for steel flanges

Brides circulaires pour tuyaux, robinets et raccords (désignées par le PN)

Partie 3. Brides en acier, en fonte et en alliage de cuivre

Section 3.1 Brides en acier — Spécifications

Runde Flansche für Rohre, Armaturen und Formstücke (nach Nenndruckstufen)

Teil 3. Flansche aus Stahl, Gußeisen und Kupferlegierungen

Abschnitt 3.1 Stahlflansche

British Standards Institution

BS 4504 : Section 3.1 : 1989

Foreword

This Section of BS 4504 has been prepared under the direction of the Piping Systems Components Standards Policy Committee and constitutes the first revision of BS 4504 : Part 1 : 1969 in respect of the steel flanges contained in that standard which will be withdrawn 12 months after the publication of this standard and BS 4504 : Section 3.2 for cast iron flanges. For Class designated steel flanges, reference should be made to BS 1560 : Section 3.1.

It was originally intended that BS 4504 : Part 1 : 1969 would be superseded by British Standards technically equivalent to (or identical with) international standards for a single series of flanges when finalized by the International Organization for Standardization (ISO) technical committee ISO/TC 5/SC 10, Metallic flanges and their joints. However, the International Standard has not been finalized but this revision of BS 4504 : Part 1 : 1969 incorporates the principles of the international work.

To align with the format of the ISO Standard, ISO 7005* 'Metallic flanges', BS 4504 : Part 3 is published in three Sections:

Section 3.1 Steel flanges

Section 3.2 Cast iron flanges

Section 3.3 Copper alloy and composite flanges

The flanges specified in this Section of BS 4504 are intended to be interchangeable with, but not necessarily identical in every detail to, steel flanges manufactured to BS 4504 : Part 1 : 1969.

This Section of BS 4504 differs from BS 4504 : Part 1 : 1969 for the content covering the steel flange requirements in the following respects.

(a) Two new flange types are introduced, loose plate flange with weld-on plate collar and loose plate flange with weld-neck collar. These types of flanges are not necessarily manufactured in the UK at the time of publication of this Section of BS 4504 but they have been included because they will be specified in ISO 7005 to which this Section of BS 4504 should eventually align.

(b) To avoid possible confusion in giving descriptive names to flange types and flange faces, all flanges are designated by code numbers and flange facings by a letter which has been based on ISO 7005.

(c) Definitions for nominal size and nominal pressure are included and are in accordance with ISO 6708 and ISO 7268 respectively.

(d) The range of nominal pressure has been limited to PN 40 as agreed by the international committee ISO/TC 5/SC 10.

(e) The pressure/temperature ratings are in accordance with ISO 7005.

(f) Materials specified have been revised, new materials added (in particular for austenitic stainless steels and nickel steels) and reference is given to comparable ASTM† materials. In addition, reference is given to

DIN‡ materials from which flanges are sometimes made. Generally, the range of materials correspond to those given in the draft ISO 7005.

(g) The dimensions of flanges given in BS 4504 : Part 1 : 1969 were based on DIN standards current at the time of publication. The essential DIN dimensions have been retained in this Section of BS 4504 but new types of flanges have been added which have dimensions based on the proposed ISO work.

(h) Tolerances have been included for a greater number of dimensions than heretofore. However, cognizance has been taken of the proposed tolerances for the international work and, in certain instances, tolerances are wider than those given in BS 4504 : Part 1 : 1969.

(j) Requirements for the surface finish of flange faces have been given in greater detail.

(k) A greater range of flange facings is included in this Section of BS 4504 to align with the draft international standard. Flanges having the full range of facings are not necessarily manufactured in the UK at the time of publication of this Section of BS 4504.

(l) Spot facing or back facing is in accordance with ISO 7005.

(m) For threaded flanges, ANSI §/ASME ¶ B.1.20.1 thread form is specified in addition to BS 21.

(n) The marking of flanges is basically in accordance with the principles of ISO 7005 but limitations on the methods are included.

(p) Appendix A is included which lists details of the information that should be supplied by the purchaser when ordering flanges.

(q) Guidance notes and recommendations contained in BS 4504 : Part 1 : 1969 have been included in an informative appendix to this Section of BS 4504. The appendix (B) is not intended to be exhaustive.

(r) Details of weld-end preparation are included for the first time (see appendix C).

(s) Details of minimum hub radius after back facing are given for the first time.

The various gasket types, dimensions, design characteristics and materials are outside the scope of this standard.

For dimensions of gaskets reference should be made to BS 4865 : Parts 1, 2, 3 and 4.

For comparison purposes the code numbers used in this Section of BS 4504 are compared with the type numbers given in BS 4504 : 1969 in appendix D.

Assessed capability. Users of this Section of BS 4504 are advised to consider the desirability of assessment and registration of a supplier's quality systems against the appropriate Part of BS 5750 by a third party certification body.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

*ISO 7005/1 is in preparation, ISO 7005/2 and ISO 7005/3 are published.

†American Society for Testing and Materials.

‡Deutsches Institut für Normung.

§American National Standards Institute.

¶American Society of Mechanical Engineers.

Contents

	Page		Page
Foreword		Inside front cover	
Committees responsible		Back cover	
Specification			
1 Scope	2	8 Dimensions of PN 2.5 flanges	17
2 Definitions	2	9 Dimensions of PN 6 flanges	19
3 Ranges of nominal size (DN)	2	10 Dimensions of PN 10 flanges	21
4 PN designations and pressure/temperature ratings	2	11 Dimensions of PN 16 flanges	23
5 Materials	3	12 Dimensions of PN 25 flanges	25
6 Bolting	3	13 Dimensions of PN 40 flanges	27
7 Repairs	3	14 Tolerances	29
8 Dimensions	4	15 Pressure/temperature ratings and bolting materials for group A ferritic steel flanges	31
9 Flange facings	4	16 Pressure/temperature ratings for group B austenitic steel flanges on a basis of 0.2 % proof stress	32
10 Spot facing or back facing of flanges	4	17 Pressure/temperature ratings for group C nickel steel flanges	33
11 Tolerances	4	18 Minimum hub radius after back facing	34
12 Marking	5	19 Steel flange descriptions and code numbers specified in BS 4504 : Section 3.1 : 1989 and BS 4504 : Part 1 : 1969	37
Appendices		Figures	
A Information to be supplied by purchaser	35	1 Flange codes	6
B Application and installation	35	2 Ancillary components for flanges. Codes 132 to 134	7
C Weld-end preparations	36	3 Flange facings: types	8
D Comparison of steel flange descriptions and code numbers specified in BS 4504 : Section 3.1 : 1989 and BS 4504 : Part 1 : 1969	37	4 Flange facings: dimensions	14
Tables		5 Dimensions of PN 2.5 flanges	16
1 Types of steel flanges and ancillary components	2	6 Dimensions of PN 6 flanges	18
2 Synoptic table	9	7 Dimensions of PN 10 flanges	20
3 Materials: ferritic steels (group A)	11	8 Dimensions of PN 16 flanges	22
4 Materials: austenitic steels (group B)	12	9 Dimensions of PN 25 flanges	24
5 Materials: nickel steels (group C)	13	10 Dimensions of PN 40 flanges	26
6 Surface finish of flange faces	13	11 Minimum hub radius after back facing	34
7 Dimensions of flange faces	15	12 Weld-end preparation	36

Specification

1 Scope

This Section of BS 4504 specifies requirements for PN designated circular steel flanges in the ranges of nominal pressure PN 2.5 to PN 40 and nominal sizes up to DN 4000 of the types given in table 1.

Table 1. Types of steel flanges and ancillary components	
Code no.	Description
101	Plate flange for welding
102	Loose plate flange with weld-on plate collar or for lapped pipe end
104	Loose plate flange with weld-neck collar
105	Blank flange
111	Weld-neck flange
112	Hubbed slip-on flange for welding
113	Hubbed threaded flange
121	Integral flange
132	Weld-on plate collar
133	Lapped pipe end
134	Weld-neck collar

NOTE. Code numbers have been made non-consecutive to permit possible future additions.

Additionally, dimensional requirements are given for ancillary components code numbers 132 to 134 (see table 1) for use with code 102 and code 104 flanges.

This Section of BS 4504 specifies the types of steel flanges and their facings, dimensions, tolerances, threading, bolt sizes, flange face surface finish, marking, materials for bolting and flange materials together with associated pressure/temperature ratings.

Bolting materials for austenitic steel and nickel steel flanges (see 6.1), the weld end preparation of weld-neck (code 111) flanges and code 134 ancillary components (see 8.1) and the routine inspection and pressure testing of flanges are outside the scope of this standard but some guidance on maximum test pressure is given in appendix B (see B.5).

NOTE. The titles of the publications referred to in this standard are listed on the inside back cover.

2 Definitions

For the purposes of this Section of BS 4504 the following definitions apply.

2.1 nominal size (DN). A numerical designation of size which is common to all components in a piping system other than components designated by outside diameters or by thread size. It is a convenient round number for reference purposes and is only loosely related to manufacturing dimensions.

NOTE 1. Nominal size is designated by the letters DN followed by the appropriate number.

NOTE 2. This definition is identical to that given in ISO 6708.

2.2 nominal pressure (PN). A numerical designation which is a convenient round number for reference purposes.

All equipment of the same nominal size (DN) designated by the same PN number shall have compatible mating dimensions.

NOTE 1. The maximum allowable working pressure depends on materials, design and working temperatures, and should be selected from the tables of pressure/temperature ratings given in this standard.

NOTE 2. Nominal pressure is designated by the letters PN followed by the appropriate reference number.

NOTE 3. This definition is identical to that given in ISO 7268.

3 Ranges of nominal size (DN)

The ranges of nominal sizes from DN 10 to DN 4000 applicable to each flange type and for each PN designation shall be as given in table 2.

4 PN designations and pressure/temperature ratings

4.1 PN designations

The range of PN designations shall be PN 2.5, PN 6, PN 10, PN 16, PN 25 and PN 40.

4.2 Pressure/temperature ratings

The pressure/temperature ratings of the flanges manufactured from the materials specified in tables 3, 4 and 5 shall be as given in tables 15, 16 and 17 for the applicable materials, and shall be the maximum allowable non-shock working gauge pressure at the temperatures shown.

NOTE 1. Linear interpolation is permitted for intermediate temperatures.

NOTE 2. The relevant pressures and temperature are those of the fluid in the pipework system.

NOTE 3. The pressure/temperature ratings of flanges depend upon the properties of the materials specified in tables 3, 4 and 5, as appropriate. For austenitic stainless steels the pressure/temperature ratings have been calculated using values of yield strength of 205 N/mm² or the 0.2 % proof stress.

NOTE 4. The rating of flanges is not necessarily the rating of the whole pipework system. Gasket materials can also impose limitations on the pressure/temperature rating of a flanged joint and the gasket manufacturer should be consulted when selecting the material of the gasket.

4.3 Rating of flanged joints

If two flanges in a flanged joint do not have the same pressure/temperature rating, the maximum permissible working pressure of the joint at any temperature shall not exceed the lower of the two pressure ratings.

5 Materials

5.1 Flange materials

Flanges shall be manufactured from materials given in tables 3, 4 or 5 as appropriate except that codes 111, 112 and 113 flanges shall be manufactured from a forging or steel casting.

NOTE 1. The materials given in tables 3, 4 and 5 are tabulated in groups having common pressure/temperature ratings as given in tables 15, 16 and 17.

NOTE 2. The purchaser should state in the enquiry and/or order if a certificate is required for the flange material (see appendix A).

5.2 Requirements governing the use of ASTM materials

5.2.1 General. Flanges manufactured from materials conforming to ASTM specifications shall comply with the following additional requirements.

1

(a) For materials to ASTM A105

(1) When specified, all forgings shall be normalized.

(2) Sub-clauses 5.2.2.1, 5.2.2.2 and 5.2.2.3 shall apply.

1

(b) For materials to ASTM A182

(1) The carbon content, by ladle analysis, of grades F304L and F316L shall not exceed 0.030 %.

(2) Sub-clause 5.2.2.3 shall apply.

(c) For materials to ASTM A387

(1) When specified, all flanges and flanged fittings shall be supplied in the normalized and tempered condition.

(2) Sub-clause 5.2.2.3 shall apply.

NOTE. The purchaser should state any specific requirements for the heat treatment conditions on the enquiry and/or order (see appendix A).

5.2.2 Carbon manganese steels

5.2.2.1 The carbon content, by ladle analysis, of the materials specified in 5.2.1 shall not exceed 0.23 % for plate and 0.25 % for forgings.

5.2.2.2 The carbon equivalent (CE_1), by ladle analysis, of the materials specified in 5.2.1 shall not exceed 0.42 where

$$CE_1 = C + \frac{Mn}{6}$$

The manufacturer shall ensure on a basis of regular production checks that the carbon equivalent (CE_2), by ladle analysis, does not exceed 0.45 where

$$CE_2 = C + \frac{Mn}{6} + \frac{Cr + Mo + V}{5} + \frac{Cu + Ni}{15}$$

5.2.2.3 The actual tensile strength of the steel of any component shall not exceed the minimum required by the relevant ASTM specification by more than 150 N/mm².

5.2.3 Chromium-molybdenum steels (applicable to material groups A5 and A6). For chromium-molybdenum steels the contents of carbon and residual elements shall be restricted as follows:

(a) Carbon content

Steels with less than 2 % Cr (nominal):

0.17 % max. (plate)

0.20 % max. (forgings and castings)

Steels with more than 2 % Cr (nominal):

0.15 % max. (plate)

0.15 % max. (forgings and castings)

(b) Residual elements

Copper 0.30 % max.

Nickel 0.40 % max.

Tungsten 0.10 % max.

Tin 0.03 % max.

5.3 Non-metallic materials

For flanges which are lined, or otherwise coated, with non-metallic materials and if the non-metallic materials come, or are likely to come, into contact with potable water then these materials shall comply with BS 6920 : Part 1.

NOTE. Users should be aware that thread sealants or lubricants, for example, should also comply with BS 6920 : Part 1 if used in potable water applications.

6 Bolting

6.1 Materials, dimensions and finish for bolting of ferritic steel flanges shall be in accordance with BS 3692, BS 4190 or BS 4882 (metric series) selected in accordance with table 15(b).

Free cutting steel for bolts, studbolts and nuts shall be restricted to the temperature range -10 °C to 100 °C and be limited to pressure designations up to and including PN 16.

NOTE. The selection of materials for bolting of flanges other than ferritic steel, is the responsibility of the user and reference should be made to BS 4882.

6.2 Studbolts shall be of the forms shown in BS 4882 except that the form shown in figure 3(b) of BS 4882 : 1973 shall only apply to studbolts of other than alloy steel.

6.3 The mating surface of all bolt heads and nuts shall be full faced.

7 Repairs

Repairs by welding, unless prohibited by the applicable material standard, or product standard in the case of integral flanges, shall be in accordance with BS 2633, BS 5135 or BS 4570 as appropriate.

NOTE. The welding procedure should be such as to produce a weld having characteristics in accordance with the parent material. Flanges should be heat treated after repair by welding when the material specification requires such treatment.

8 Dimensions

8.1 Flange dimensions

Dimensions, except for the diameter of shoulder, G (see note 4), of each type of flange for each PN shall be as given in tables 8 to 13, and as qualified by clause 10 and the notes to tables 8 to 13, if appropriate.

NOTE 1. It is incumbent upon the purchaser to specify in the enquiry and/or order if dimensions of flanges are to be affected by clause 10 and/or the notes to tables 8 to 13.

NOTE 2. A summary of the various types of flanges specified showing the nominal sizes (DN) applicable to each type and to each PN is given in table 2.

NOTE 3. The details for the weld preparation for weld-neck flanges (code 111) and code 134 ancillary components are not a requirement of this standard but attention is drawn to appendix C which gives details of various weld-end preparations and it is incumbent upon the purchaser to specify a particular weld-end preparation, if required. The weld-end preparation shown in figures 12a or 12b is the preparation normally supplied.

NOTE 4. The centre portion of the face of a blank flange (code 105) need not be machined provided that the diameter of the unmachined portion does not exceed the recommended shoulder diameter, G , given in tables 8 to 13.

8.2 Hubs

The hubs of slip-on for welding (code 112) and threaded (code 113) flanges shall be either:

- (a) parallel; or
- (b) have a draft angle of not greater than 7° on the outside surface for forging or casting purposes.

8.3 Threaded flanges

8.3.1 The threads of hubbed threaded flanges (code 113) shall be taper or parallel in accordance with BS 21 or taper to ANSI/ASME B1.20.1.

NOTE. BS 21 parallel threads will be supplied unless the purchaser specifies otherwise (see appendix A).

8.3.2 The thread shall be concentric with the axis of the flange and misalignment shall not exceed 5 mm/m.

Flanges shall be manufactured without a counterbore but to protect the threads the threads shall be chamfered to the major diameter of the thread at the back of the flange at an angle between 40° and 50° with the axis of the thread. The chamfer shall be concentric with the thread and shall be included in the measurement of the thread length provided that the chamfer does not exceed one pitch in length.

8.3.3 Gauging shall be in accordance with BS 21 or ANSI/ASME B1.20.1 as appropriate.

8.4 Bolt holes

Bolt holes shall be equally spaced on the pitch circle diameter and in the case of integral flanges, shall be positioned off-centre.

9 Flange facings

9.1 Range of facings

The range of flange facings and flange face designations are given in figure 3. Dimensions of facings shall be as given in figure 4 and table 7.

For flange facings types B, D and F the transition from the edge of the raised face to the flange face shall be by:

- (a) radius; or
- (b) chamfer.

9.2 Lapped joints

For code 133 ancillary components for flanges the finished height of the facing shall be not less than the specified pipe thickness used. If a tongue or groove face is required the thickness of the lap remaining after machining the facing shall not be less than the specified thickness of the pipe used.

9.3 Facing finishes

9.3.1 All flange jointing faces shall be machine finished and when compared by visual or tactile means with reference specimens, shall be in accordance with the values given in table 6.

NOTE 1. It is not intended that instrument measurements be taken on the faces themselves and the R_a and R_z values as defined in BS 1134 relate to the reference specimens.

NOTE 2. Requirements for special coatings or finishes should be stated in the enquiry and/or order so that an appropriate allowance may be incorporated in the machining of any relevant mating dimensions (see appendix A).

9.3.2 Flat face, raised face and spigot/recess facings types A, B, E and F shall be machined to comply with the requirements of table 6.

9.3.3 For tongue and groove and O-ring groove facings types C, D, G and H the gasket contact surfaces shall be machined to produce a surface finish in accordance with the values given in table 6.

10 Spot facing or back facing of flanges

Any spot facing or back facing shall not reduce the flange thickness to less than the thickness specified. When spot facing is used the diameter shall be large enough to accommodate the outside diameter of the equivalent normal series of washers complying with BS 4320 for the metric bolt size being fitted. The bearing surfaces for the bolting shall be parallel to the flange face within the limits given in table 14.

When a flange is back faced a minimum fillet radius at the hub, R_{min} (see figure 11), shall be maintained as given in table 18.

11 Tolerances

Tolerances on dimensions of flanges shall be as given in table 14.

12 Marking

12.1 Other than integral flanges

All flanges, other than integral, shall be marked as follows.

- (a) Number of this British Standard, i.e. BS 4504*.
- (b) Flange code number, e.g. 112.
- (c) Nominal pressure (PN), e.g. PN 40.
- (d) Nominal size (DN), e.g. DN 150.
- (e) Material designation. The material group or identification symbols given in tables 3, 4 and 5 shall be used, as appropriate.
- (f) Manufacturer's name or trade mark.
- (g) Cast number or melt identification or suitable quality control number traceable to the cast number.
- (h) Thread identification (see 12.2).

Example: BS 4504/111-PN 16 - DN 400 - A2 - XXX - 12345

NOTE 1. Additionally, the type of flange face may be specified using the designations given in figure 4.

Example: BS 4504/111/B - PN 16 - DN 400 - A2 - XXX - 12345

NOTE 2. Where a flange is subsequently used to form an integral part of a component and the component has a lower pressure rating than that of the flange, the lower rating should be clearly marked on the component.

12.2 Internal thread identification

Threaded flanges shall be marked to indicate the type of thread used.

Threads to BS 21 shall be designated by the letter Rc or Rp as appropriate followed by the nominal size, e.g. Rc 3/4. Threads to ANSI/ASME B1.20.1 shall be designated by the nominal size, number of threads per inch and the letters NPT, e.g. 3/4-14NPT.

12.3 Stamping

Where steel stamps are used, the marking shall be positioned on the rim of the flange.

NOTE. Care should be taken to ensure that steel stamp markings are not liable to cause cracks in the flange material.

12.4 Omission of markings

If a flange is too small to enable all the markings required in 12.1 to be marked on the flange, then some of the markings are permitted to be omitted. The order in which the markings are omitted shall be as follows.


- (a) Size.
- (b) Thread type and designation.
- (c) PN designation.
- (d) Manufacturer's name or trade mark.




*Marking BS 4504, together with the flange code number, on or in relation to a product represents a manufacturer's declaration of conformity, i.e. a claim by or on behalf of the manufacturer that the product meets the requirements of this Section of BS 4504. The accuracy of the claim is therefore solely the responsibility of the person making the claim. Such a declaration is not to be confused with third party certification of conformity, which may also be desirable.




Code 101
Plate flange for welding

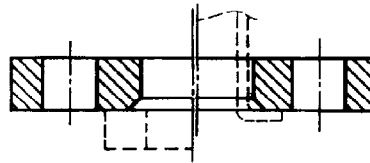


Code 102
Loose plate flange with weld-on
plate collar (see code 132) or
lapped pipe end (see code 133)

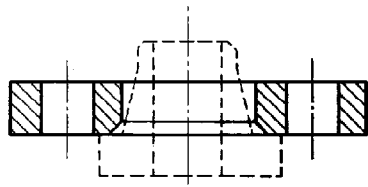


Code 104
Loose flange with welding
neck collar (see code 134)

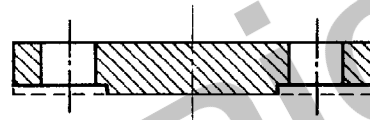


Code 105
Blank flange

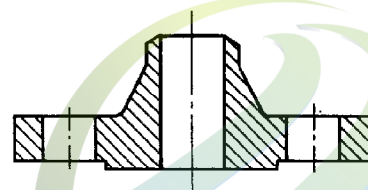


Code 111
Weld-neck flange

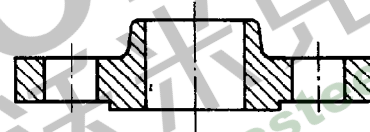

Code 112
Hubbed slip-on flange for welding

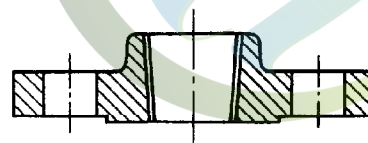

Code 113
Hubbed threaded flange

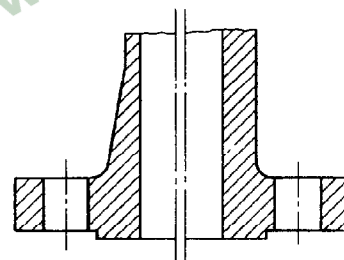


Code 121
Integral

NOTE 1. These sketches are diagrammatic only.

NOTE 2. Codes 101 to 105 inclusive comprise flanges that do not incorporate a hub or weld-neck. Codes 111 to 113 inclusive comprise flanges incorporating a hub or weld-neck manufactured from forgings or steel castings. Code 121 is an integral part of some other equipment or component.


NOTE 3. Flanges may be designated by code numbers or by descriptions.

Figure 1. Flange codes

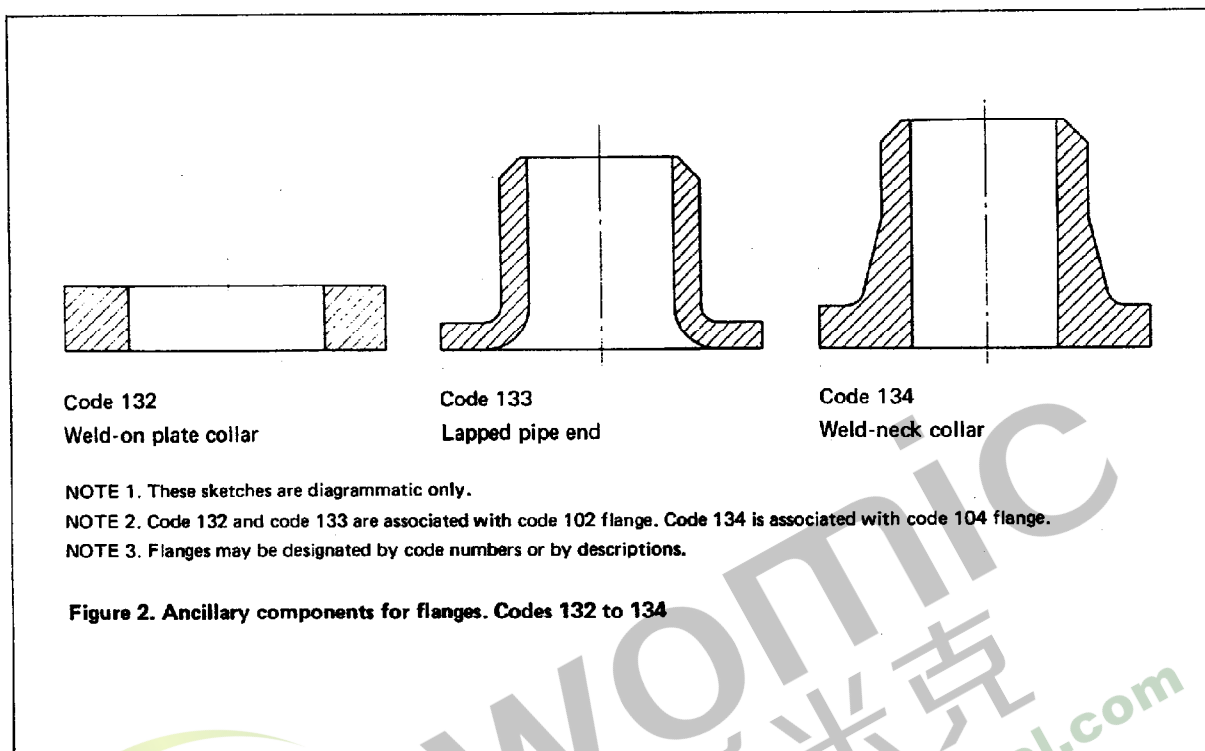





Type A
Flat face

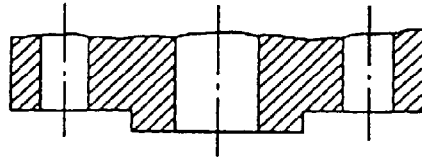


Type E
Spigot

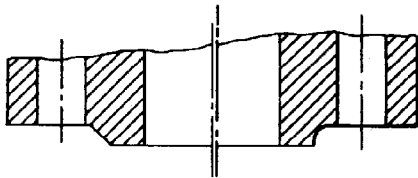

Type B
Raised face

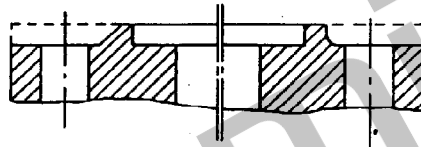


Type F
Recess

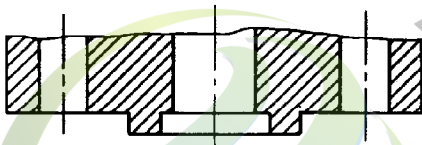


Type C
Tongue



Type G
O-ring recess

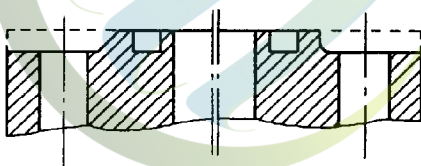

Type D
Groove

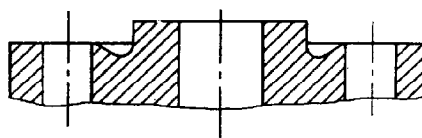

Type H
O-ring groove

NOTE 1. The transition from the edge of the raised face to the flange face may be by radius or chamfer (see 9.1).

NOTE 2. Sketches designated A to H inclusive illustrate the various types of flange facings which may be used in conjunction with the flanges or components given in figures 1 and 2.

NOTE 3. Facings may be designated by type letters or by descriptions.

Figure 3. Flange facings: types

Table 2. Synoptic table

Flange and code no.	Table	DN	PN																				
			2.5	6	10	16	25	40	6	10	16	25	40	10	16	25	40	2.5	6	10	16	25	40
Plate 	8	2.5	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	9	6	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	10	10	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	11	16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	12	25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	13	40	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	9	6	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	10	10	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	11	16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	12	25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	13	40	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	Loose plate with weld-on plate collar or lapped pipe and 	9	6	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		10	10	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
11		16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
12		25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
13		40	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Loose with weld-neck collar 	10	10	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	11	16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	12	25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	13	40	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Blank 	8	2.5	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	9	6	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	10	10	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	11	16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	12	25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Table 2 (concluded)





Flange and code no.	Table	DN		PN																					
		PN	2.5	6	10	16	25	40	6	10	16	25	40	6	10	16	25	40	6	10	16	25	40		
Weld neck 	8		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	11		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	12		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	13		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	11		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	12		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	13		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	Hubbed slip-on for welding 	9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
11			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
12			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
13			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
9			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
10			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
11			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
12			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
13			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Hubbed threaded 		9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		11		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	12		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	13		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	11		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	12		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	13		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
	Integral 	9		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		10		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
		11		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
12			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
13			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
9			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
10			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
11			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
12			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
13			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	

Table 3. Materials: ferritic steels (group A)*

Materials	Plates		Forgings		Castings		Group No.†
	British Standard	Other standards‡	British Standard	Other standards‡	British Standard	Other standards‡	
Low grade carbon steel	BS 1501: Part 1 - 151 Grade 360 BS 4360 Grade 43A	ASTM A515 Grade 55 ASTM A283 Grade C DIN 17100 † R.St 37.2	BS 970: Part 1 - 070M20	ASTM A181 Class 60 DIN 17100† R.St 37.2	—	—	A1
Carbon steel	BS 1501: Part 1 - 161 Grade 360 BS 1501: Part 1 - 151 Grade 430A	ASTM A515 Grade 55	BS 970: Part 1 - 070M20	—	—	—	A2
High grade carbon steel and carbon manganese steels	BS 1501: Part 1 - 164 Grade 360 BS 4360 - Grade 508 BS 1501: Part 1 - 224 Grade 400	ASTM A515 Grade 55 ASTM A283 Grade D ASTM A516 Grade 60	BS 1503 - 224 Grade 410 BS 1503 - 221 Grade 430 BS 1503 - 164 Grade 490	ASTM A350 Grade LF2 DIN 17243 - C22.8 ASTM A105	BS 1504 - 161 Grade 430 L140 BS 1504 - 161 Grade 480	ASTM A352 Grade LCB ASTM A216 Grade WCB	A3
Carbon molybdenum steel	BS 1501: Part 1 - 243§	ASTM A204 Grade A	BS 1503 - 245 Grade 420	ASTM A182 Grade F1	BS 1504 - 245	ASTM A217 Grade WC1	A4
1 % chromium ½ % molybdenum steel	BS 1501: Part 2 - 620	ASTM A387 Grade 12 Class 2	BS 1503 - 620 Grade 440	ASTM A182 Grade F12	—	—	A5
1½ % chromium ½ % molybdenum steel	BS 1501: Part 2 - 621	ASTM A387 Grade 11 Class 2	BS 1503 - 621 Grade 460	ASTM A182 Grade F11	BS 1504 - 621	ASTM A217 Grade WC6	A5
2¼ % chromium 1 % molybdenum steel	BS 1501: Part 2 - 622 - 515	ASTM A387 Grade 22 Class 2	BS 1503 - 622 Grade 490	ASTM A182 Grade F22	BS 1504 - 622	ASTM A217 Grade WC9	A6

*Group numbers relate to the pressure/temperature ratings given in table 15.

†Refer to BS 1560: Section 3.1 or ASTM specifications for limitations or recommendations in respect to ASTM materials.

‡The use of DIN 17100 R.St 37.2 is limited to PN 16.

§BS 1501-243 material is not suitable for use above 400 °C.

NOTE. Where materials are used below 0 °C refer to the application code.

Materials		Plates			Forgings		Castings			Group No.*
		British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	
Austenitic chromium-nickel (low carbon) steel	BS 1501: Part 3 - 304S12	BS 1501: Part 3 - 304S12	ASTM A240 - 304L	BS 1503 - 304S11	ASTM A182 Grade F304L	BS 1504 - 304C12	ASTM A351 Grade CF3	BS 1504 - 304C12	ASTM A351 Grade CF3	B1
Austenitic chromium-nickel steel	BS 1501: Part 3 - 304S15	BS 1501: Part 3 - 304S15	ASTM A240 - 304 ASTM A240 - 304H	BS 1503 - 304S31 BS 1503 - 304S51	ASTM A182 Grade F304 ASTM A182 Grade F304H	BS 1504 - 304C15	ASTM A351 Grade CF8	BS 1504 - 304C15	ASTM A351 Grade CF8	B2
Austenitic chromium-nickel (niobium stabilized) steel	BS 1501: Part 3 - 347S17 BS 1501: Part 3 - 347S49	BS 1501: Part 3 - 347S17 BS 1501: Part 3 - 347S49	ASTM A240 - 347 ASTM A240 - 347H	BS 1503 - 347S31 BS 1503 - 347S51	ASTM A182 Grade F347 ASTM A182 Grade F347H	BS 1504 - 347C17	ASTM A351 Grade CF8C	BS 1504 - 347C17	ASTM A351 Grade CF8C	B3
Austenitic chromium-nickel (titanium stabilized) steel	BS 1501: Part 3 - 321S12 BS 1501: Part 3 - 321S49	BS 1501: Part 3 - 321S12 BS 1501: Part 3 - 321S49	ASTM A240 - 321 ASTM A240 - 321H	BS 1503 - 321S31 BS 1503 - 321S51	ASTM A182 Grade F321 ASTM A182 Grade F321H	—	—	—	—	B3
Austenitic chromium-nickel-molybdenum (low carbon) steel	BS 1501: Part 3 - 316S12	BS 1501: Part 3 - 316S12	ASTM A240 - 316L	BS 1503 - 316S11	ASTM A182 Grade F316L	BS 1504 - 316C12	ASTM A351 Grade CF3M	BS 1504 - 316C12	ASTM A351 Grade CF3M	B4
Austenitic chromium-nickel-molybdenum steel	BS 1501: Part 3 - 316S16	BS 1501: Part 3 - 316S16	ASTM A240 - 316 ASTM A240 - 316H	BS 1503 - 316S31 BS 1503 - 316S51	ASTM A182 Grade F316 ASTM A182 Grade F316H	BS 1504 - 316C16	ASTM A351 Grade CF8M	BS 1504 - 316C16	ASTM A351 Grade CF8M	B5
Austenitic 25 % chromium - 20 % nickel steel	BS 1501: Part 3 - 310S24	BS 1501: Part 3 - 310S24	ASTM A240 - 310S	BS 1503 - 310S31	ASTM A182 Grade F310	BS 1504 - 310C40	ASTM A351 Grade HK40 ASTM A351 Grade CK20	BS 1504 - 310C40	ASTM A351 Grade HK40 ASTM A351 Grade CK20	B5

*Group numbers relate to the pressure/temperature ratings given in table 16.

†Refer to BS 1560: Section 3.1 or ASTM specifications for limitations or recommendations in respect to ASTM materials.

NOTE: Where materials are used below 0 °C refer to the application code.

2

1

Table 5. Materials: nickel steels (group C)*

Materials	Plates		Forgings		Castings		Group No.†
	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	
3% nickel steel	BS 1501 : Part 2 - 503	ASTM A203 Grade A	BS 1503 - 503 LT80	—	BS 1504 - 503 LT60	ASTM A352 Grade LC3	C1
9% nickel steel	BS 1501 : Part 2 - 510	ASTM A353 ASTM A553 Type 1	BS 1503 - 509 LT196 BS 1503 - 510 LT196	ASTM A522 type 1 ASTM A522 type 1	—	—	C2


*Group numbers relate to the pressure/temperature ratings given in table 17.
†Refer to ASTM specifications for limitations or recommendations in respect to ASTM materials.
NOTE. Where materials are used below 0 °C and/or above 120 °C refer to the application code.

Table 6. Surface finish of flange faces

Facing types	Method of machining	R_a^*		R_z^*	
		min.	max.	min.	max.
A, B	Turning†	3.2	12.5	12.5	50
E, F	Other than turning	3.2	6.3	12.5	25
C, D G, H	—	0.8	3.2	3.2	12.5

* R_a and R_z are defined in BS 1134.
†The term 'turning' includes any method of machine operation producing either serrated concentric or serrated spiral grooves.
NOTE. For certain applications, e.g. low temperature gases, it may be necessary to stipulate closer control of the surface finish.

BS 4504 : Section 3.1 : 1989

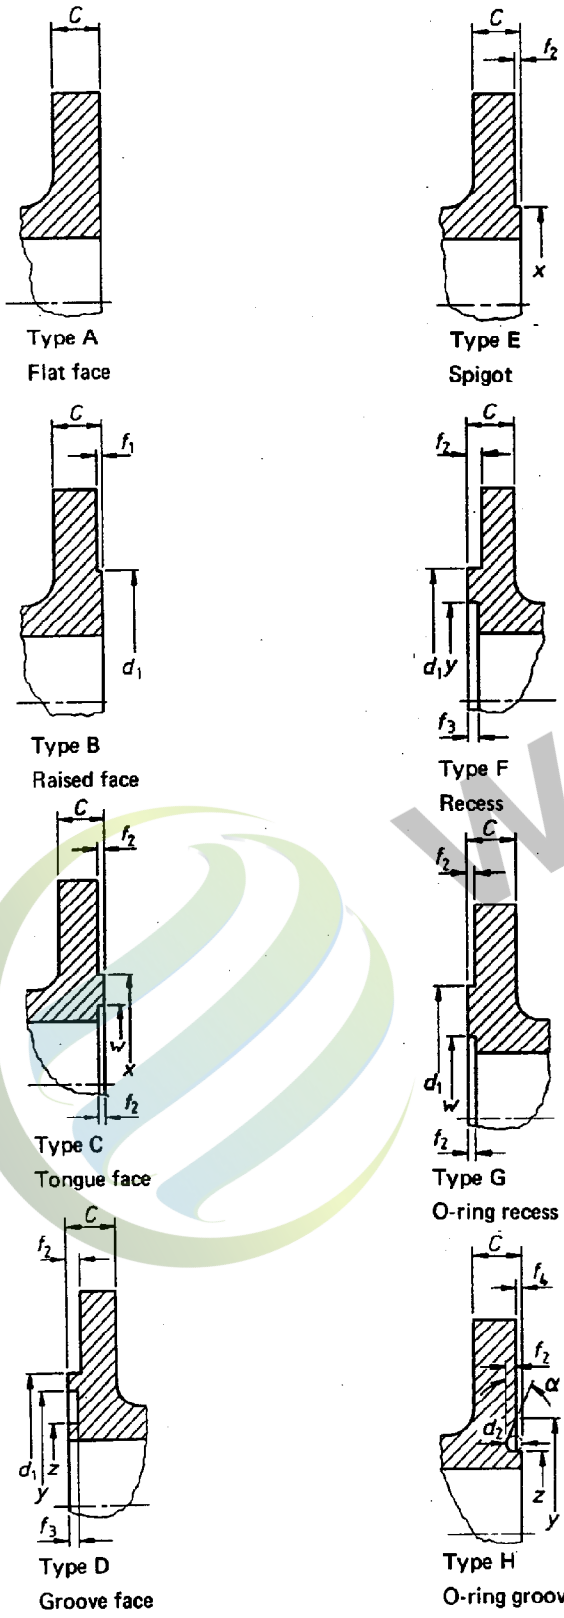


NOTE. Dimension C includes the raised face thickness (see tables 8 to 13).

Figure 4. Flange facings: dimensions (See table 7).

Table 7. Dimensions of flange faces

Nominal size DN	d ₁					f ₁	f ₂	f ₃	f ₄	w	x	y	z	α	d ₂			
	PN 2.5	PN 6	PN 10	PN 16	PN 25											PN 40		
10	Use PN 6 dimensions	35	Use PN 40 dimensions	40	162	2	4	3	2	24	34	35	23	41° 16'	5			
15		40		45												188	188	
20		50		58												212	218	188
25		60		68												268	278	218
32		70		78												320	335	268
40		80		88												370	395	320
50		90		102												430	450	370
65		110		122												482	505	430
80		128		138												532	555	482
100		148		162												585	615	532
125		188	610	615	585	3	4.5	3.5	129	149	150	128	32° 15'	6				
150	202	212	725	720	610													
200	258	268	800	820	725													
250	312	320	905	930	800													
300	365	370	1000	1030	905													
350	415	430	1115	1140	1000													
400	465	482	1330	1350	1115													
450	520	532	1535	1560	1330													
500	570	585	1760	1780	1535													
600	670	685	1960	1985	1760													
700		775	2170	2210	1960	4	5	4	2062	2092	2094	2060	28° 39'	8				
800	880	905	2370	2440	2170													
900	980	1005	2570	2780	2370													
1000	1080	1110	2780	3000	2570													
1200	1295	1330	3160	3370	2780													
1400	1510	1535	3370	3580	3160													
1600	1690	1710	3720	3920	3370													
1800	1890	1920	4120	—	3720													
2000	2090	2125	—	—	4120													
2200	2295	2335	—	—	—													
2400		2495	—	—	—	5	6	6	1662	1692	1694	1660	—	—				
2600	2695	2750	—	—	1662													
2800	2910	2960	—	—	1692													
3000	3110	3160	—	—	1694													
3200	3310	3370	—	—	1862													
3400	3510	3580	—	—	1862													
3600	3720	3790	—	—	2062													
3800	—	—	—	—	—													
4000	—	—	—	—	—													

3

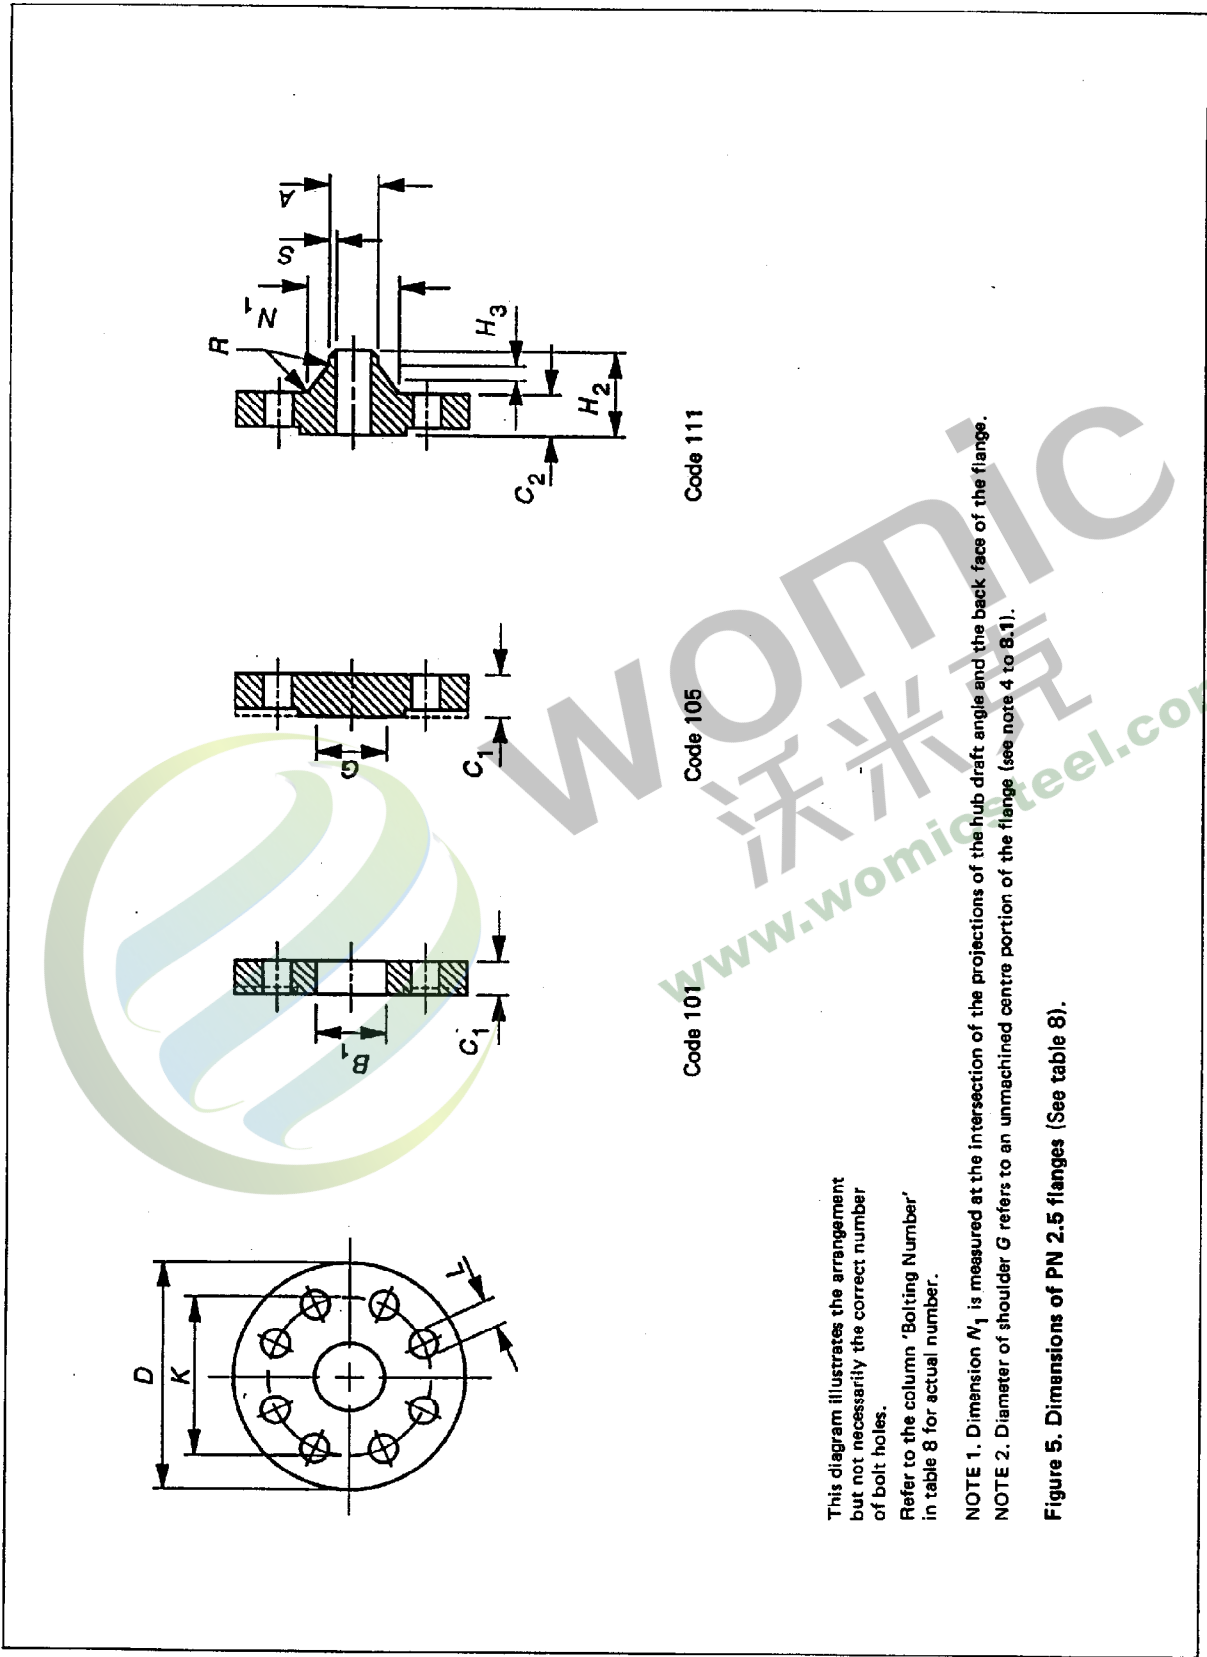

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes.

Refer to the column 'Bolting Number' in table 8 for actual number.

NOTE 1. Dimension N_1 is measured at the intersection of the projections of the hub draft angle and the back face of the flange.

NOTE 2. Diameter of shoulder G refers to an unmachined centre portion of the flange (see note 4 to 8.1).

Figure 5. Dimensions of PN 2.5 flanges (See table 8).

Nominal size	Mating dimensions												Nominal size							
	DN	D	K	L	Diameter of bolt circle	Diameter of bolt hole	Bolting		Outside diameter of neck	Bore diameter	Flange thickness			Diameter of shoulder	Lengths		Neck diameter	Corner radii	Neck thickness	DN
							Number	Size			C ₁	C ₂			H ₂	H ₃				
Codes affected	101, 105, 111																			
10 to 600	Use PN 6 rating (dimensions for these sizes are identical)																			
700	860	810	26	24	M24	711	To be specified by the purchaser	36	24	mm	mm	mm	70	16	740	12	To be specified by the purchaser	700		
800	975	920	30	24	M27	813	To be specified by the purchaser	38	26	mm	mm	mm	70	16	842	12	To be specified by the purchaser	800		
900	1075	1020	30	24	M27	914	To be specified by the purchaser	40	26	mm	mm	mm	70	16	942	12	To be specified by the purchaser	900		
1000	1175	1120	30	28	M27	1016	To be specified by the purchaser	42	26	mm	mm	mm	70	16	1045	12	To be specified by the purchaser	1000		
1200	1375	1320	30	32	M27	1220	To be specified by the purchaser	44	26	mm	mm	mm	70	16	1245	16	To be specified by the purchaser	1200		
1400	1575	1520	30	36	M27	1420	To be specified by the purchaser	48	26	mm	mm	mm	70	16	1445	16	To be specified by the purchaser	1400		
1600	1790	1730	30	40	M27	1620	To be specified by the purchaser	51	26	mm	mm	mm	80	20	1645	16	To be specified by the purchaser	1600		
1800	1990	1930	30	44	M27	1820	To be specified by the purchaser	54	26	mm	mm	mm	80	20	1845	16	To be specified by the purchaser	1800		
2000	2190	2130	30	48	M27	2020	To be specified by the purchaser	58	26	mm	mm	mm	80	22	2045	16	To be specified by the purchaser	2000		
2200	2405	2340	33	52	M30	2220	To be specified by the purchaser	—	28	mm	mm	mm	90	25	2248	18	To be specified by the purchaser	2200		
2400	2605	2540	33	56	M30	2420	To be specified by the purchaser	—	28	mm	mm	mm	90	25	2448	18	To be specified by the purchaser	2400		
2600	2805	2740	33	60	M30	2620	To be specified by the purchaser	—	28	mm	mm	mm	90	25	2648	18	To be specified by the purchaser	2600		
2800	3030	2960	36	64	M33	2820	To be specified by the purchaser	—	30	mm	mm	mm	90	25	2848	18	To be specified by the purchaser	2800		
3000	3230	3160	36	68	M33	3020	To be specified by the purchaser	—	30	mm	mm	mm	90	25	3050	18	To be specified by the purchaser	3000		
3200	3430	3360	36	72	M33	3220	To be specified by the purchaser	—	30	mm	mm	mm	90	25	3250	20	To be specified by the purchaser	3200		
3400	3630	3560	36	76	M33	3420	To be specified by the purchaser	—	32	mm	mm	mm	95	28	3450	20	To be specified by the purchaser	3400		
3600	3840	3770	36	80	M33	3620	To be specified by the purchaser	—	32	mm	mm	mm	100	28	3652	20	To be specified by the purchaser	3600		
3800	4045	3970	39	80	M36	3820	To be specified by the purchaser	—	34	mm	mm	mm	100	28	3852	20	To be specified by the purchaser	3800		
4000	4245	4170	39	84	M36	4020	To be specified by the purchaser	—	34	mm	mm	mm	100	28	4052	20	To be specified by the purchaser	4000		

NOTE 1. For facing dimensions see table 7.

NOTE 2. See notes following table 13.

1

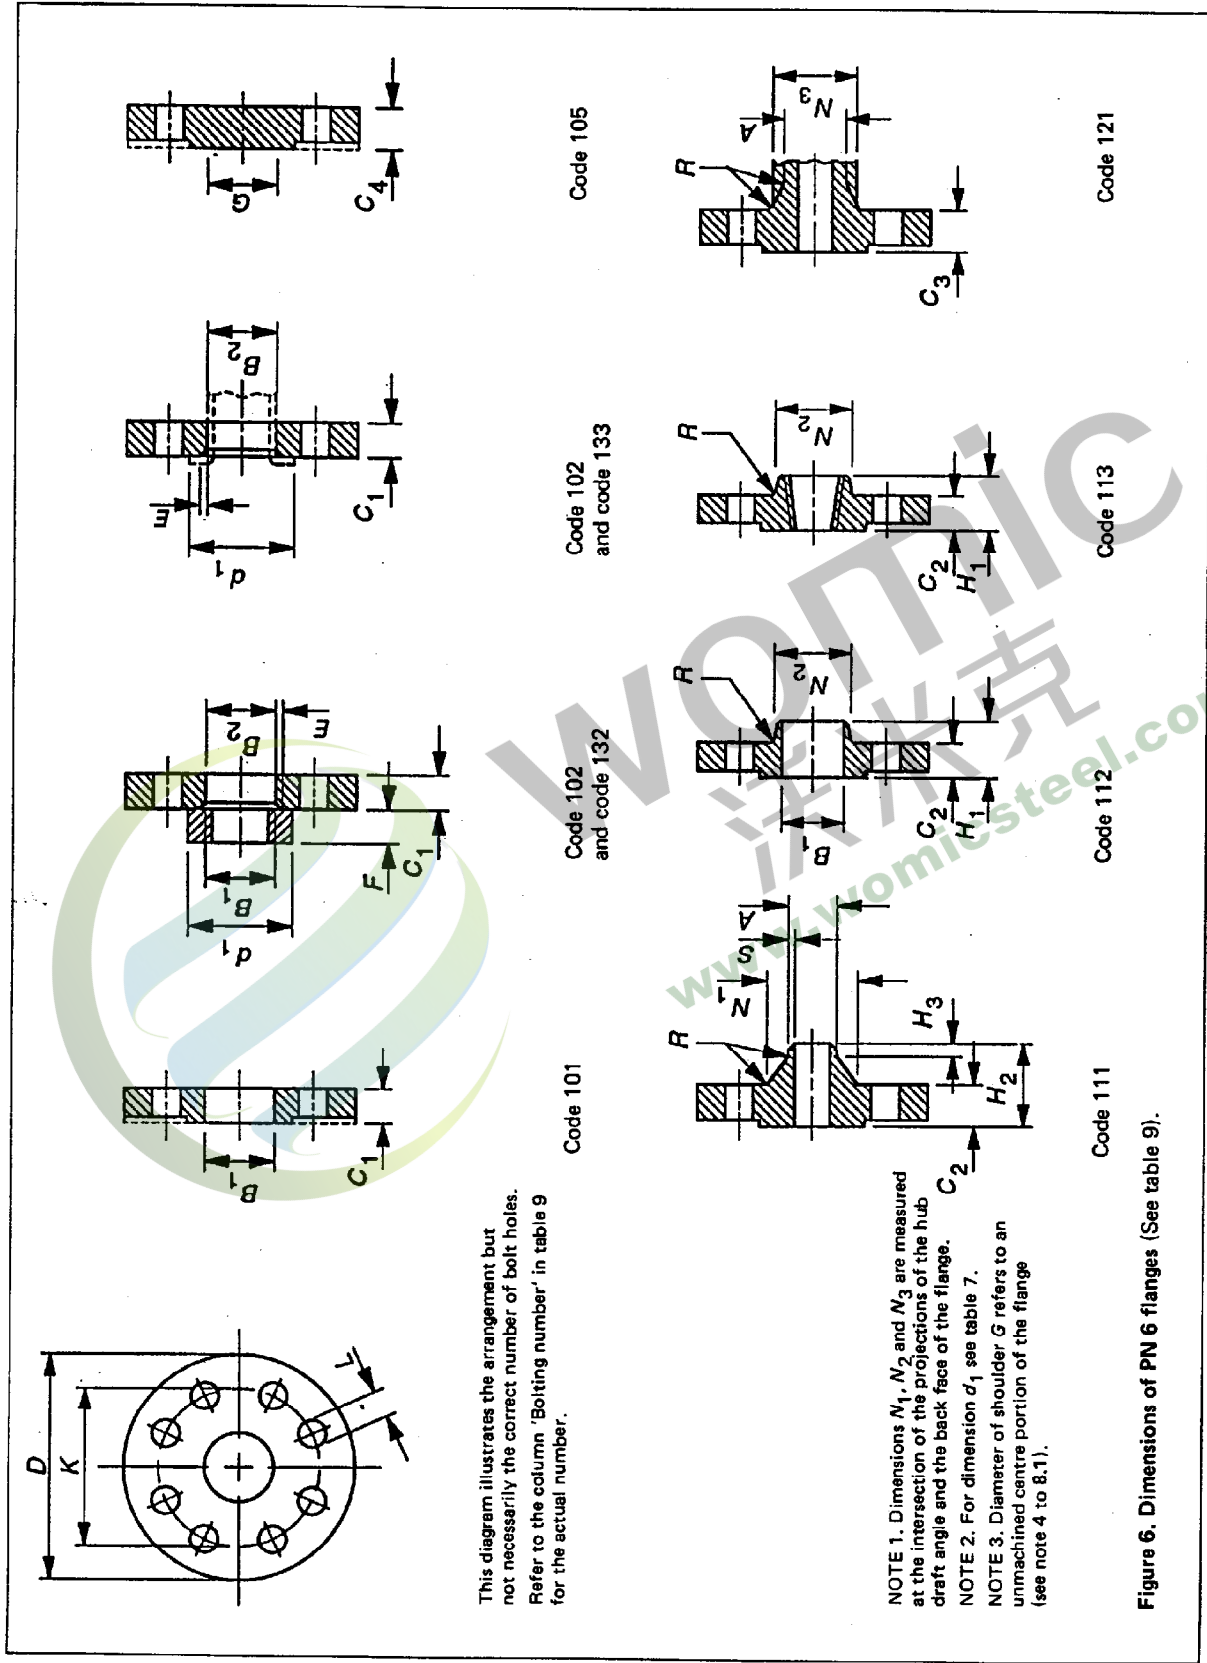


Figure 6. Dimensions of PN 6 flanges (See table 9).

Table 9. Dimensions of PN 6 flanges (See figure 9).

Nominal size DN	Mating dimensions			Outside diameter of neck A	Bore diameters			Flange thickness			Chamfer E	Collar thickness F	Diameter of shoulder G	Lengths			Neck diameters			Corner radii R	Neck thickness S	Nominal size DN
	Outside diameter D	Diameter of bolt circle K	Diameter of bolt hole L		Bolting Number	B ₁	B ₂	C ₁	C ₂ C ₃	C ₄				H ₁	H ₂	H ₃	N ₁	N ₂	N ₃			
Codes affected	101, 102, 105, 111, 112, 113, 121			111 121	101 112 132	102	101 102 111 112 113 121	102	105	102	132	105	105	112 113	111	111	111	112 113	121	111	111	
10	75	50	11	17.2	18.0	21	12	12	12	3	10	—	20	28	6	26	25	20	3	1.8	10	
15	80	55	11	21.3	22.0	25	12	12	12	3	10	—	20	30	6	30	30	26	3	2.0	15	
20	90	65	11	26.9	27.5	31	14	14	14	4	10	—	24	32	6	38	40	34	4	2.3	20	
25	100	75	11	33.7	34.5	38	14	14	14	4	10	—	24	35	6	42	50	44	4	2.5	25	
32	120	90	14	42.4	43.5	46	14	14	14	5	10	—	26	35	6	55	60	54	5	2.6	32	
40	130	100	14	48.3	49.5	53	14	14	14	5	10	—	26	38	7	62	70	64	5	2.6	40	
50	140	110	14	60.3	61.5	65	16	14	14	5	12	—	28	38	8	74	80	74	5	2.9	50	
65	160	130	14	76.1	77.5	81	16	14	14	6	12	55	32	38	9	88	100	94	6	2.9	65	
80	190	160	18	88.9	90.5	94	16	16	16	6	12	70	34	42	10	102	110	110	6	3.2	80	
100	210	170	18	114.3	116.0	120	18	16	16	6	14	90	40	45	10	130	130	130	6	3.6	100	
125	240	200	18	139.7	141.5	145	20	18	18	6	14	115	44	48	10	155	160	160	6	4.0	125	
150	265	225	18	168.3	170.5	174	20	18	18	6	14	140	44	48	12	184	185	182	8	4.5	150	
200	320	280	18	219.1	221.5	226	22	20	20	6	16	190	44	55	15	236	240	238	8	5.6	200	
250	375	335	18	273.0	276.5	281	24	22	22	8	18	235	44	60	15	290	295	284	10	6.3	250	
300	440	395	22	323.9	327.5	333	24	22	22	8	18	285	44	62	15	342	355	342	10	7.1	300	
350	490	445	22	355.6	359.5	365	26	22	22	8	18	325	—	62	15	385	392	392	10	7.1	350	
400	540	495	22	406.4	411.0	416	28	22	22	8	20	375	—	65	15	438	442	442	10	7.1	400	
450	595	550	22	457.0	462.0	467	30	24	24	8	20	425	—	65	15	492	—	494	12	7.1	450	
500	645	600	22	508.0	513.5	519	30	24	24	8	22	475	—	68	15	538	—	544	12	7.1	500	
600	755	705	26	610.0	616.5	622	32	24	34	8	22	575	—	70	16	640	—	642	12	7.1	600	
700	860	810	26	711.0	—	—	40*	24	38	—	—	—	—	70	16	740	—	746	12	7.1	700	
800	975	920	30	813.0	—	—	44*	24	42	—	—	—	—	70	16	842	—	850	12	7.1	800	
900	1075	1020	30	914.0	—	—	48*	26	46	—	—	—	—	70	16	942	—	950	12	7.1	900	
1000	1175	1120	30	1016.0	—	—	52*	26	52	—	—	—	—	70	16	1045	—	1050	12	7.1	1000	
1200	1405	1340	33	1220.0	—	—	60*	28	60	—	—	—	—	90	20	1248	—	1264	12	8.0	1200	
1400	1630	1560	36	1420.0	—	—	68*	32	68	—	—	—	—	90	20	1452	—	1480	12	8.0	1400	
1600	1830	1760	36	1620.0	—	—	76*	34	76	—	—	—	—	90	20	1655	—	1680	12	9.0	1600	
1800	2045	1970	39	1820.0	—	—	84*	36	84	—	—	—	—	100	20	1855	—	1878	15	10.0	1800	
2000	2265	2180	42	2020.0	—	—	92*	38	92	—	—	—	—	110	25	2058	—	2082	15	11.0	2000	
2200	2475	2390	42	2220.0	—	—	—	42	—	—	—	—	—	115	25	2260	—	—	15	—	2200	
2400	2685	2600	42	2420.0	—	—	—	44	—	—	—	—	—	125	25	2462	—	—	15	—	2400	
2600	2905	2810	48	2620.0	—	—	—	46	—	—	—	—	—	130	25	2665	—	—	15	—	2600	
2800	3115	3020	48	2820.0	—	—	—	48	—	—	—	—	—	135	30	2865	—	—	15	—	2800	
3000	3315	3220	48	3020.0	—	—	—	50	—	—	—	—	—	140	30	3068	—	—	15	—	3000	
3200	3525	3430	48	3220.0	—	—	—	54	—	—	—	—	—	150	30	3272	—	—	15	—	3200	
3400	3735	3640	48	3420.0	—	—	—	56	—	—	—	—	—	160	35	3475	—	—	15	—	3400	
3600	3970	3860	56	3620.0	—	—	—	60	—	—	—	—	—	165	35	3678	—	—	15	—	3600	

*For code 101 flanges only.

NOTE 1. For facing dimensions see table 7.

NOTE 2. See notes following table 13.


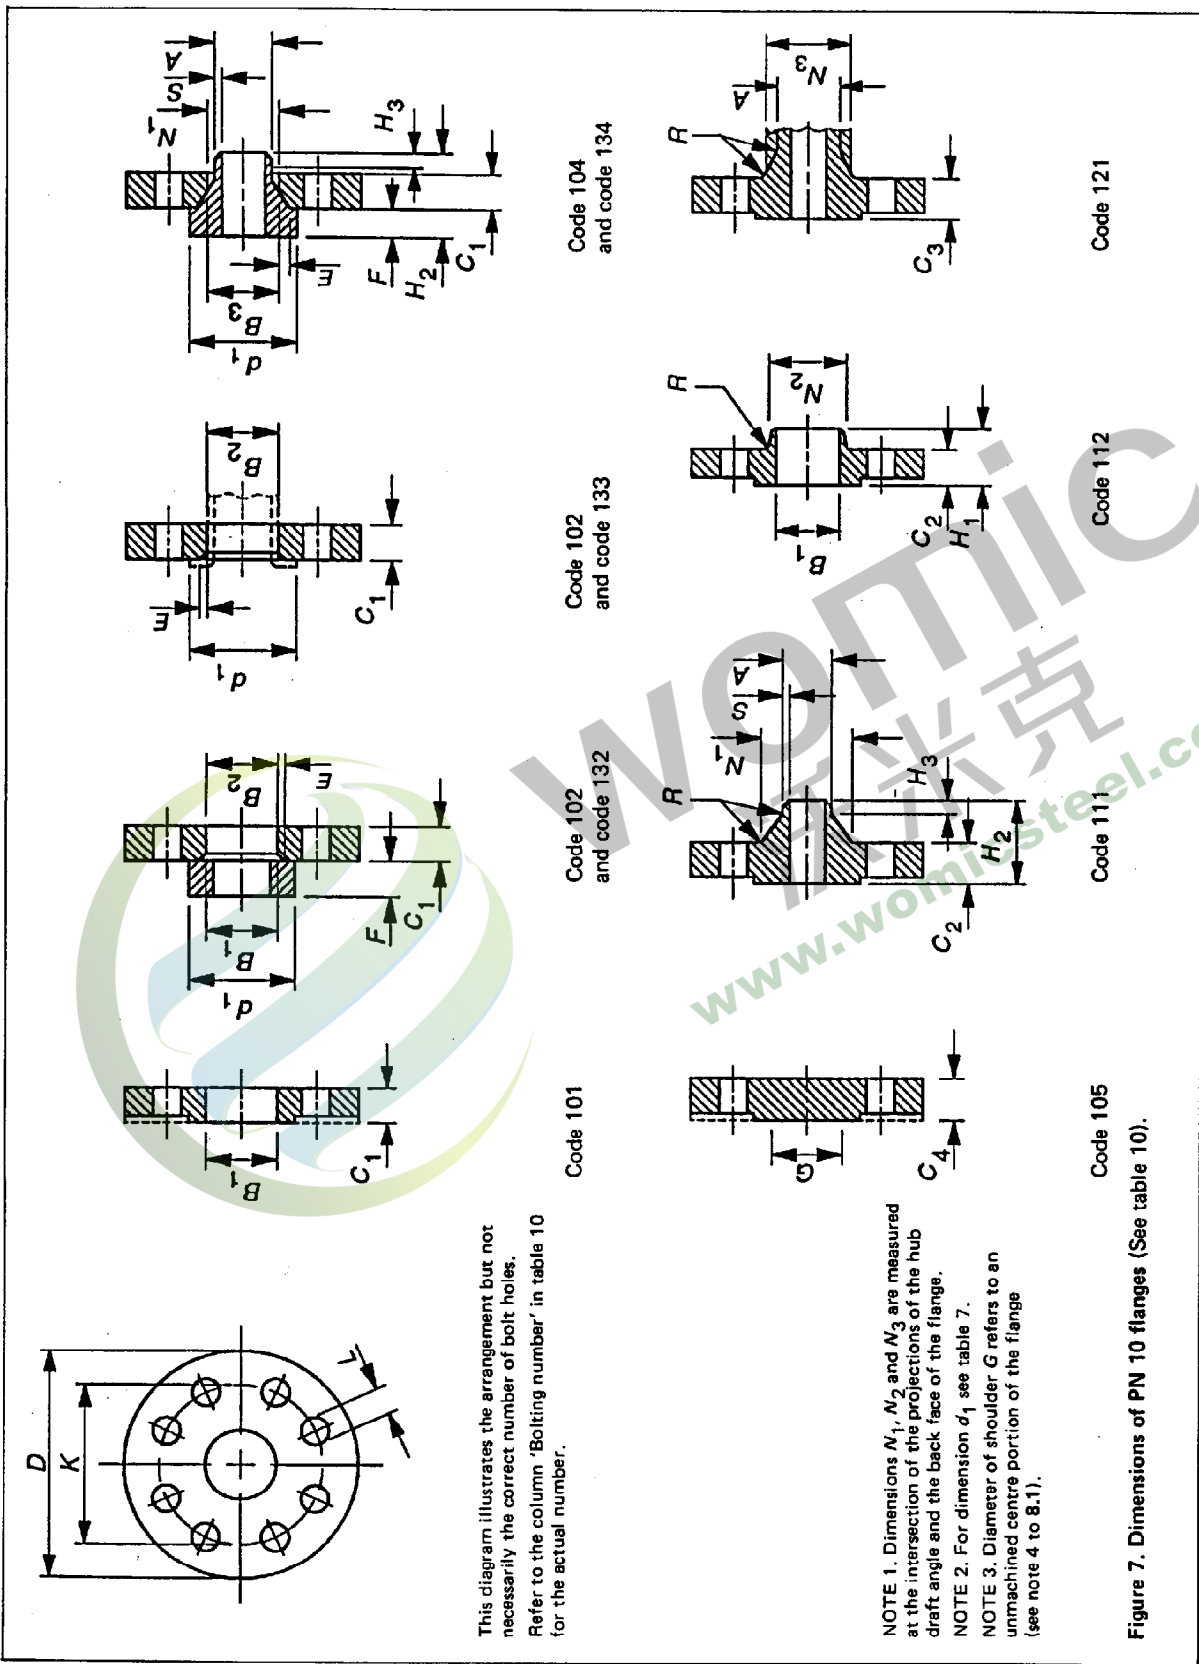



Table 10. Dimensions of PN 10 flanges (See figure 7).

Nominal size DN	Mating dimensions				Outside diameter of neck A	Bore diameters			Flange thickness			Chamfer E	Collar thickness F	Diameter of shoulder G	Lengths			Neck diameters			Corner radii	Neck thickness S	Nominal size DN			
	Outside diameter D	Diameter of bolt circle K	Diameter of bolt hole L	Bolting Number Size		B ₁	B ₂	B ₃	C ₁	C ₂	C ₃				C ₄	H ₁	H ₂	H ₃	N ₁	N ₂				N ₃		
																									mm	mm
Codes affected	101, 102, 104, 105, 111, 112, 121				111, 121, 134	101, 112, 132	102, 104	101, 102, 104	101, 102, 104	111, 112, 104	102, 104	102, 132, 134	105	112, 134	111, 134	111, 134	111, 121	111, 121	111, 121	111, 134						
10																										
15																										
20																										
25																										
32																										
40																										
50																										
65																										
80																										
100																										
125																										
150																										
Use PN 16 dimensions																										
200	340	295	22	8	M20	221.5	226	240	24	24	24	6	20	190	44	62	15	234	246	246	246	8	5.6	200		
250	395	350	22	12	M20	276.5	281	294	26	26	26	8	22	235	46	68	16	298	298	298	10	6.3	250			
300	445	400	22	12	M20	327.5	333	348	26	26	26	8	22	285	46	68	16	342	350	348	10	7.1	300			
350	505	460	22	16	M20	359.5	365	400	28	26	26	8	22	325	53	68	16	390	400	408	10	7.1	350			
400	565	515	26	16	M24	411.0	416	450	32	26	26	8	24	375	57	72	16	440	456	456	10	7.1	400			
450	615	565	26	20	M24	457.0	467	498	36	28	28	8	24	425	63	72	16	488	502	502	12	7.1	450			
500	670	620	26	20	M24	508.0	519	550	38	28	28	8	26	475	67	75	16	540	559	559	12	7.1	500			
600	780	725	30	20	M27	610.0	622	650	42	28	28	8	28	575	75	80	18	640	658	658	12	7.1	600			
700	895	840	30	24	M27	711.0	-	-	30	34	38	-	-	670	-	80	18	746	-	-	12	8.0	700			
800	1015	950	33	24	M30	813.0	-	-	32	36	42	-	-	770	-	80	18	848	-	-	12	8.0	800			
900	1115	1050	33	28	M30	914.0	-	-	34	38	46	-	-	860	-	95	20	948	-	-	12	10.0	900			
1000	1230	1160	36	28	M33	1016.0	-	-	34	38	52	-	-	960	-	95	20	1050	-	-	12	10.0	1000			
1200	1455	1360	39	32	M36	1220.0	-	-	38	44	60	-	-	1160	-	115	25	1256	-	-	12	11.0	1200			
1400	1675	1590	42	36	M39	1420.0	-	-	42	48	-	-	-	-	-	120	25	1460	-	-	12	12.0	1400			
1600	1915	1820	48	40	M45	1620.0	-	-	46	52	-	-	-	-	-	130	25	1666	-	-	12	14.0	1600			
1800	2115	2020	48	44	M45	1820.0	-	-	50	56	-	-	-	-	-	140	30	1866	-	-	15	15.0	1800			
2000	2325	2230	48	48	M45	2020.0	-	-	54	60	-	-	-	-	-	150	30	2070	-	-	15	16.0	2000			
2200	2550	2440	56	52	M52	2220.0	-	-	58	-	-	-	-	-	-	160	35	2275	-	-	18	18.0	2200			
2400	2760	2650	56	56	M52	2420.0	-	-	62	-	-	-	-	-	-	170	35	2478	-	-	18	18.0	2400			
2600	2960	2850	56	60	M52	2620.0	-	-	66	-	-	-	-	-	-	180	40	2680	-	-	18	18.0	2600			
2800	3180	3070	56	64	M52	2820.0	-	-	70	-	-	-	-	-	-	190	40	2882	-	-	18	18.0	2800			
3000	3405	3290	62	68	M56	3020.0	-	-	75	-	-	-	-	-	-	200	45	3085	-	-	18	18.0	3000			


NOTE 1. For facing dimensions see table 7.
NOTE 2. See notes following table 13.

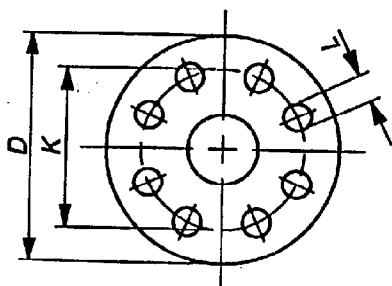

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes. Refer to the column 'Bolting number' in table 11 for the actual number.

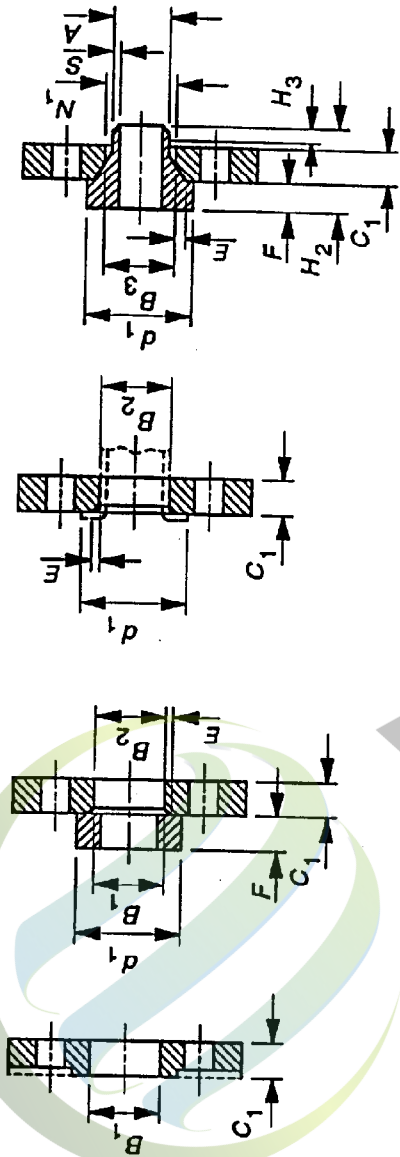

Code 101
Code 102 and code 132
Code 102 and code 133
Code 104 and code 134

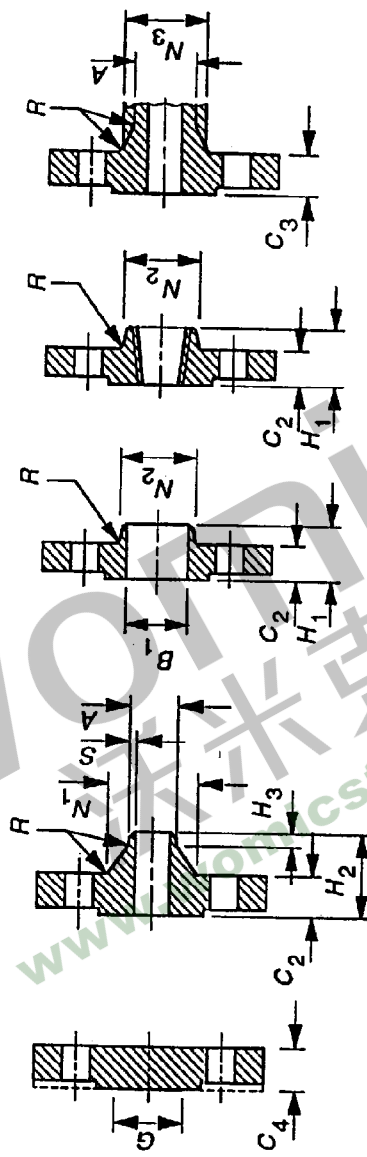

Code 105
Code 111
Code 112
Code 113
Code 121

NOTE 1. Dimensions N_1 , N_2 and N_3 are measured at the intersection of the projections of the hub draft: angle and the back face of the flange.
NOTE 2. For dimension d_1 see table 7.
NOTE 3. Diameter of shoulder G refers to an unmachined centre portion of the flange (see note 4 to 8.1).

Figure 8. Dimensions of PN 16 flanges (See table 11).

Table 11. Dimensions of PN 16 flanges (See figure 8).

Nominal size DN	Mating dimensions				Outside diameter of neck A	Bore diameters			Flange thickness			Chamfer E	Collar thickness F	Diameter of shoulder G	Lengths			Neck diameters			Radius R	Neck thickness S	Nominal size DN		
	Outside diameter D	Diameter of bolt circle K	Diameter of bolt hole L	Bolting Number		B ₁	B ₂	B ₃	C ₁	C ₂	C ₃				C ₄	C _A	H ₁	H ₂	H ₃	N ₁				N ₂	N ₃
Codes affected	101, 102, 104, 105, 111, 112, 113, 121				111, 121 134	101 102 132	104	101 102 104	111 112 113	121 105	102 104	132 134	105	111 113	111 134	111 134	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121	111 112 113 121
10	90	60	14	4	M12	18.0	21	31	14	14	3	12	105	111	111	111	6	28	30	28	3	3	1.8	10	
15	95	65	14	4	M12	22.0	25	35	14	14	3	12	105	111	111	111	6	28	30	28	3	3	2.0	15	
20	105	75	14	4	M12	27.5	31	42	16	16	4	14	105	111	111	111	6	28	30	28	3	3	2.3	20	
25	115	85	14	4	M12	33.7	38	49	16	16	4	14	105	111	111	111	6	28	30	28	3	3	2.6	25	
32	140	100	18	4	M16	42.4	43.5	47	16	16	5	14	105	111	111	111	6	28	30	28	3	3	2.6	32	
40	150	110	18	4	M16	48.3	49.5	53	16	16	5	14	105	111	111	111	6	28	30	28	3	3	2.6	40	
50	165	125	18	4	M16	60.3	61.5	65	16	16	5	14	105	111	111	111	6	28	30	28	3	3	2.9	50	
65	185	145	18	4	M16	76.1	77.5	81	16	16	6	16	105	111	111	111	6	28	30	28	3	3	2.9	65	
80	200	160	18	8	M18	88.9	90.5	94	14	20	6	16	105	111	111	111	6	28	30	28	3	3	3.2	80	
100	220	180	18	8	M18	114.3	116.0	120	14	20	6	16	105	111	111	111	6	28	30	28	3	3	3.6	100	
125	250	210	18	8	M18	139.7	141.5	145	16	22	6	18	105	111	111	111	6	28	30	28	3	3	4.0	125	
150	285	240	22	8	M20	168.3	170.5	174	18	22	6	20	105	111	111	111	6	28	30	28	3	3	4.5	150	
200	340	295	22	12	M20	219.1	221.5	226	24	24	6	20	105	111	111	111	6	28	30	28	3	3	5.8	200	
250	405	355	26	12	M24	273.0	276.5	281	29	26	8	22	105	111	111	111	6	28	30	28	3	3	6.3	250	
300	460	410	26	12	M24	323.9	327.5	333	34	28	8	24	105	111	111	111	6	28	30	28	3	3	7.1	300	
350	520	470	26	16	M24	355.6	359.0	365	30	30	8	26	105	111	111	111	6	28	30	28	3	3	8.0	350	
400	580	525	30	16	M27	406.4	411.0	416	38	32	8	28	105	111	111	111	6	28	30	28	3	3	8.0	400	
450	640	585	30	20	M27	457.0	462.0	467	40	34	8	30	105	111	111	111	6	28	30	28	3	3	8.0	450	
500	715	650	33	20	M30	508.0	513.5	510	46	36	8	32	105	111	111	111	6	28	30	28	3	3	8.0	500	
600	840	770	36	20	M33	610.0	616.5	622	52	36	8	32	105	111	111	111	6	28	30	28	3	3	8.8	600	
700	910	840	36	24	M33	711.0	717.0	723	60*	36	8	32	105	111	111	111	6	28	30	28	3	3	8.8	700	
800	1025	950	39	24	M36	813.0	819.0	825	68*	38	42	32	105	111	111	111	6	28	30	28	3	3	10.0	800	
900	1125	1050	39	28	M36	914.0	920.0	926	76*	40	44	32	105	111	111	111	6	28	30	28	3	3	10.0	900	
1000	1255	1170	42	28	M39	1016.0	1022.0	1028	84*	42	46	32	105	111	111	111	6	28	30	28	3	3	10.0	1000	
1200	1485	1390	48	32	M45	1220.0	1226.0	1232	98*	48	52	32	105	111	111	111	6	28	30	28	3	3	12.5	1200	
1400	1685	1590	48	36	M45	1420.0	1426.0	1432	98*	48	52	32	105	111	111	111	6	28	30	28	3	3	14.2	1400	
1600	1930	1820	56	40	M52	1620.0	1626.0	1632	98*	48	52	32	105	111	111	111	6	28	30	28	3	3	16.0	1600	
1800	2130	2020	56	44	M52	1820.0	1826.0	1832	98*	48	52	32	105	111	111	111	6	28	30	28	3	3	17.5	1800	
2000	2345	2230	62	48	M56	2020.0	2026.0	2032	98*	48	52	32	105	111	111	111	6	28	30	28	3	3	20.0	2000	


*For code 101 flanges only.

†Flanges of nominal size DN 65 can be supplied with 8 bolt holes upon special request by the purchaser.

NOTE 1. For facing dimensions see table 7.

NOTE 2. See notes following table 13.



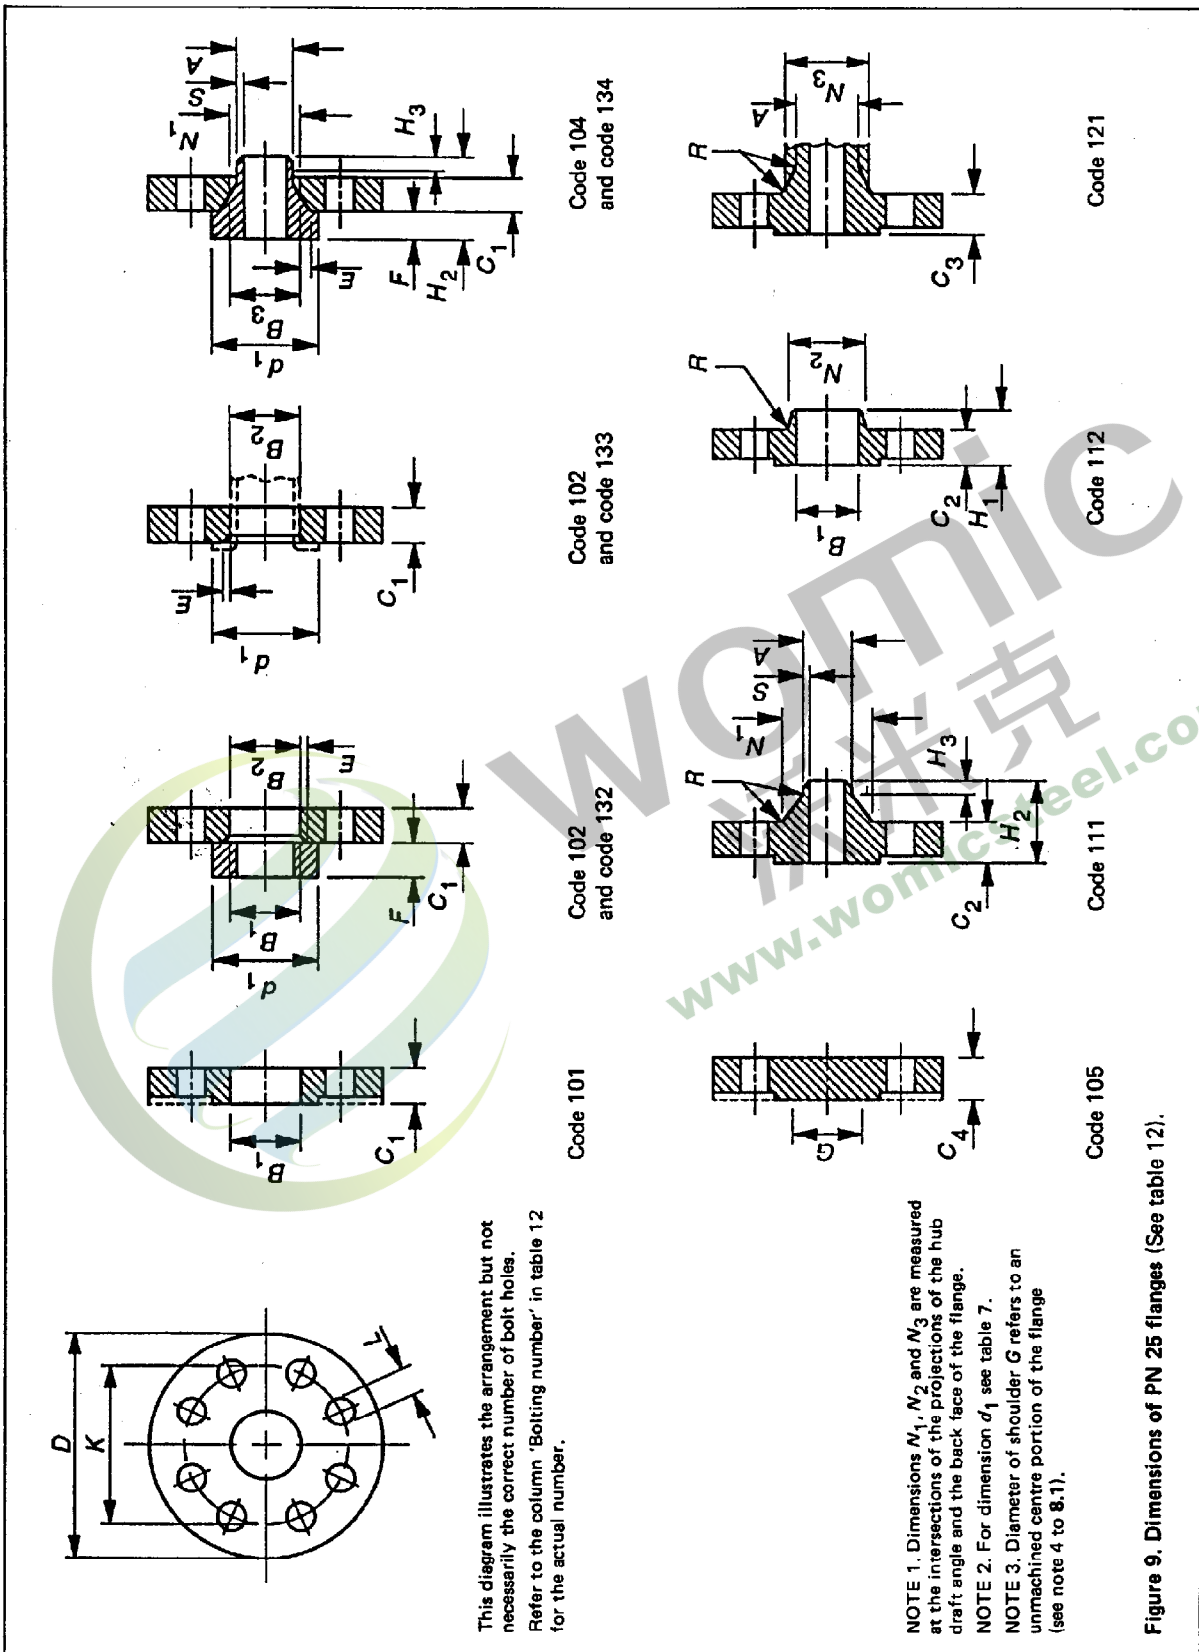


This diagram illustrates the arrangement but not necessarily the correct number of bolt holes. Refer to the column 'Bolting number' in table 12 for the actual number.

Figure 9. Dimensions of PN 25 flanges (See table 12).



Table 12. Dimensions of PN 25 flanges (See figure 9).

Nominal size DN	Mating dimensions				Outside diameter of neck A	Bore diameters			Flange thickness				Chamfer E	Codes thickness F	Diameter of shoulder G	Lengths			Neck diameters			Corner radii R	Neck thickness S	Nominal size DN
	Outside Diameter D	Diameter of bolt circle K	Diameter of bolt hole L	Bolting Num: Size bor		E ₁	E ₂	E ₃	C ₁	C ₂	C ₃	C ₄				H ₁	H ₂	H ₃	N ₁	N ₂	N ₃			
10	360	310	26	12	221.5	226	250	32	30	30	30	6	26	190	52	80	16	252	8	200				
15	425	370	30	12	276.5	281	302	35	32	32	32	8	26	235	60	88	18	304	10	250				
20	485	430	30	16	327.5	333	356	38	34	34	34	8	28	285	67	92	18	364	10	300				
25	555	490	33	16	359.5	365	408	42	38	38	38	8	32	325	72	100	20	398	10	350				
30	620	550	36	16	411.0	416	462	46	40	40	40	8	34	375	78	110	20	472	10	400				
35	670	600	36	20	462.0	467	510	50	42	42	42	8	36	426	84	110	20	500	12	450				
40	730	660	36	20	513.5	519	568	56	44	44	44	8	38	475	90	125	20	568	12	500				
45	845	770	39	20	616.5	622	670	68	46	46	46	8	40	575	100	125	20	660	12	600				
50	960	875	42	24	711.0	717	766	76	48	48	48	8	42	684	110	135	22	780	12	700				
55	1085	990	48	24	813.0	819	868	86	50	50	50	8	44	793	120	145	24	882	12	800				
60	1185	1090	48	28	914.0	920	969	96	54	54	54	8	46	892	130	155	24	984	12	900				
65	1320	1210	56	28	1016.0	1022	1071	106	58	58	58	8	48	991	140	170	24	1086	12	1000				
70	1530	1420	56	32	1220.0	1226	1275	126	70	70	70	8	50	1190	150	190	24	1296	12	1200				
75	1755	1640	62	36	1420.0	1426	1475	146	76	76	76	8	52	1390	160	210	24	1508	12	1400				
80	1975	1860	62	40	1620.0	1626	1675	166	84	84	84	8	54	1590	170	220	24	1726	12	1600				
85	2185	2070	70	44	1820.0	1826	1875	186	90	90	90	8	56	1790	180	230	24	1942	12	1800				
90	2425	2300	70	48	2020.0	2026	2075	206	96	96	96	8	58	1990	190	240	24	2158	15	2000				

NOTE 1. For facing dimensions see table 7.
NOTE 2. See notes following table 13.

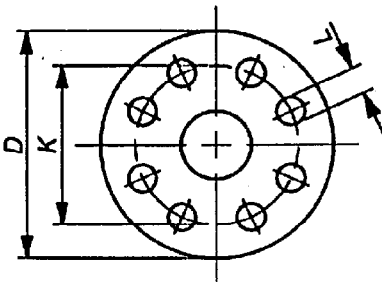

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes. Refer to the column 'Bolting number' in table 13 for the actual number.

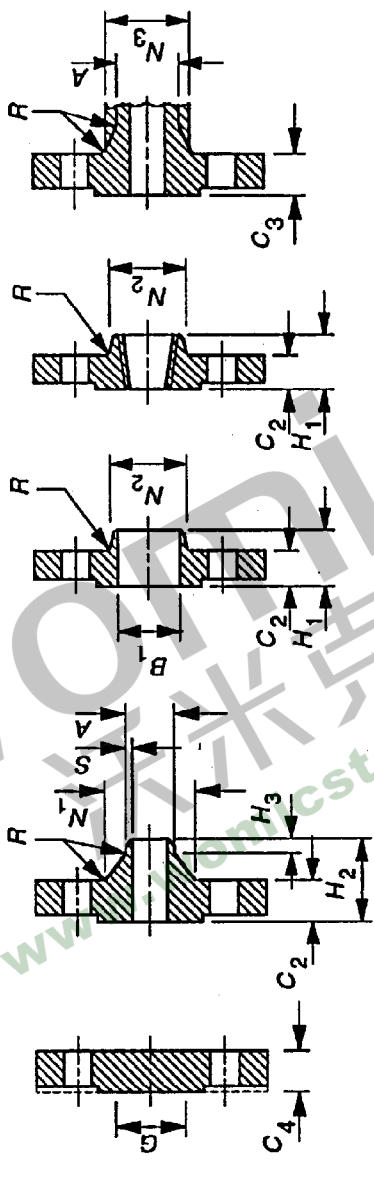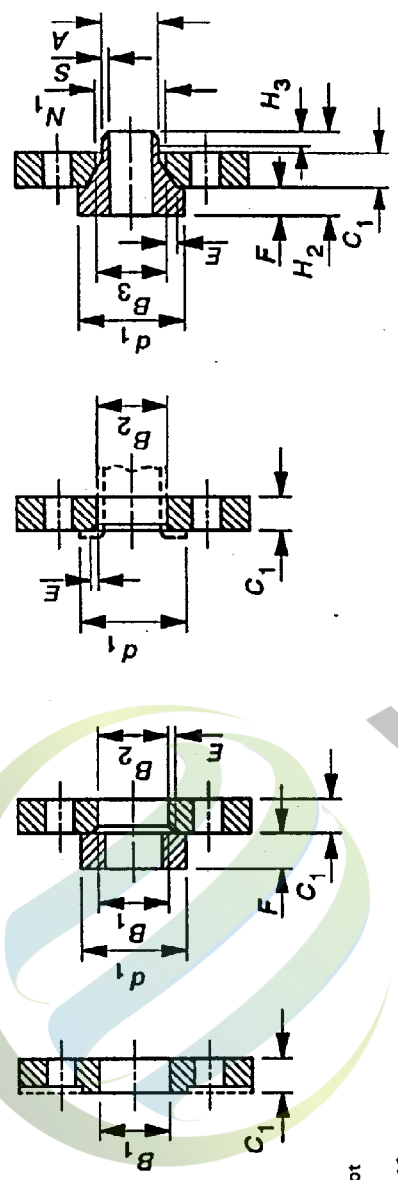

NOTE 1. Dimensions M_1 , M_2 and M_3 are measured at the intersections of the projections of the hub draft angle and the back face of the flange.
 NOTE 2. For dimension d_1 see table 7.
 NOTE 3. Diameter of shoulder G refers to an unmachined centre portion of the flange (see note 4 to 8.1).

Figure 10. Dimensions of PN 40 flanges (See table 13).

Table 13. Dimensions of PN 40 flanges (See figure 10).

Nominal size DN	Mating dimensions				Outside diameter of neck A	Bore diameters			Flange thickness				Chamfer and stud thickness F	Diameter of shoulder G	Lengths			Neck diameters			Radius R	Neck thickness S	Nominal size DN	
	Outside diameter	Diameter of bolt circle K	Diameter of bolt hole L	Bolting Num-ber		B ₁	B ₂	B ₃	C ₁	C ₂	C ₃	C ₄			E	H ₁	H ₂	H ₃	N ₁	N ₂				N ₃
Codes affected	101, 102, 104, 105, 111, 112, 113, 121	111, 121	134		101, 112, 132	102	104	101, 102, 104	111, 112, 113	105	102, 104	132, 134	112, 113	111, 134	111, 134	111, 134	111, 134	112, 113	121	111, 112, 113, 121	111, 134			
10	90	60	14	4	M12	18.0	21	31	14	16	3	12	22	35	6	28	30	28	3	1.8	10			
15	95	65	14	4	M12	22.0	25	35	14	16	3	12	22	38	6	32	35	32	3	2.0	15			
20	105	75	14	4	M12	27.5	31	42	16	18	4	14	26	40	6	40	45	40	4	2.3	20			
25	115	85	14	4	M12	33.7	34.5	38	16	18	4	14	28	40	6	46	52	50	4	2.6	25			
32	140	100	18	4	M16	42.4	43.5	47	18	18	5	14	30	42	6	56	60	60	5	2.6	32			
40	150	110	18	4	M16	48.3	49.5	53	18	18	5	14	32	45	7	64	70	70	5	2.6	40			
50	165	125	18	4	M16	60.3	61.5	65	18	20	5	16	34	48	8	74	84	84	5	2.9	50			
65	185	145	18	8	M16	76.1	77.5	81	22	22	6	16	38	52	10	92	104	104	6	2.9	65			
80	200	160	18	8	M16	88.9	90.5	94	24	24	6	18	40	58	12	110	118	120	6	3.2	80			
100	235	190	22	8	M20	114.3	116.0	120	28	24	6	20	44	65	12	134	145	142	6	3.6	100			
125	270	220	26	8	M24	139.7	141.5	145	32	26	6	22	48	72	12	152	162	162	6	4.0	125			
150	300	250	26	8	M24	168.3	170.5	174	36	28	8	24	52	75	12	190	200	192	8	4.5	150			
200	375	320	30	12	M27	219.1	221.5	226	42	34	6	28	58	85	16	244	260	254	8	6.3	200			
250	450	385	33	12	M30	273.0	276.5	281	48	38	8	30	60	105	18	306	312	312	10	7.1	250			
300	515	450	33	16	M30	323.9	327.5	333	54	42	8	34	67	115	18	362	380	378	10	8.0	300			
350	580	510	36	16	M33	355.6	359.5	365	60	46	8	36	72	125	20	408	424	432	10	8.8	350			
400	660	585	39	16	M36	406.4	411.0	416	66	50	8	42	78	135	20	462	478	498	10	11.0	400			
450	685	610	39	20	M36	457.0	462.0	467	72	54	8	46	84	135	20	500	522	522	12	12.5	450			
500	755	670	42	20	M39	508.0	513.5	519	72	56	8	50	90	140	20	562	576	576	12	14.2	500			
600	890	795	48	20	M45	610.0	616.5	622	84	60	8	54	100	150	20	666	686	686	12	16.0	600			

NOTE 1. For facing dimensions see table 7.
NOTE 2. See notes following this table.

BS 4504 : Section 3.1 : 1989

Notes to tables 8 to 13

NOTE 1. For tolerances see clause 11 and table 14.

NOTE 2. For facings see clause 9, figures 3 and 4.

NOTE 3. For spot facing or back facing see clause 10.

NOTE 4. For threads in threaded flanges see 8.3.

NOTE 5. Neck diameter N_1 , N_2 and N_3 is the theoretical maximum which will permit the use of ring spanners or the fitting if required of the normal series of washers to BS 4320* without some form of additional machining such as spot facing (see clause 11).

NOTE 6. The bore diameter B_1 , B_2 and B_3 in sizes above DN 600 should be specified by the purchaser.

NOTE 7. The minimum neck thickness (dimension S) has been selected from the pipe thickness given in BS 3600 in accordance with one of the preferred series from ISO 4200 : 1980 as follows:

(a) PN 2.5 and 6 Series D;

(b) PN 10 and 16 Series E;

(c) PN 25 and 40 Series F.

NOTE 8. The neck thickness S for weld-neck (code 11) flanges should be specified by the purchaser if different from the dimension listed in the tables (see appendix A).

NOTE 9. The outside diameter of the neck is approximately equal to the outside diameter of the pipe complying with BS 3600.

NOTE 10. The external diameter and thickness of the pipe to be joined to the flange should be specified by the purchaser where these dimensions affect the bore of the flange (see appendix A).

NOTE 11. The bore sizes of code 121 flanges are usually equal to the nominal size of the pipe, valve or fitting to which they form a part and the actual bore sizes are usually given in the appropriate standard(s) for the component.

NOTE 12. In respect of threaded flanges the outside diameters of the following pipes are as given below:

Nominal size	Threaded to BS 21	Threaded to ANSI/ASME B1.20.1
DN 65	mm 76.1	mm 73.0
DN 125	139.1	141.3
DN 150	165.1	168.3

In respect of other types of flanges which are to be connected to pipes complying with American standards the outside diameters of the following pipes will be:

(a) DN 65 73.0 mm;

(b) DN 125 141.3 mm.

*The washer may theoretically overlap slightly the corner radius but in practice it is deemed that there is sufficient space to fit the washer satisfactorily.

Table 14. Tolerances			
Dimension	Flange code	Tolerance	Size
Outside diameter of neck <i>A</i>	111, 121, 134	mm +3.0 -0	≤ DN 125
		+4.5 -0	> DN 125 ≤ DN 1200
		+6.0 -0	> DN 1200
Bore diameter <i>B</i> ₁ , <i>B</i> ₂ , <i>B</i> ₃	101, 102, 104, 112, 132,	+0.5 -0	≤ DN 100
		+1.0 -0	> DN 100 ≤ DN 400
		+1.5 -0	> DN 400 ≤ DN 600
		+3.0 -0	> DN 600
Outside diameter <i>D</i>	121	±4.0	≤ DN 250
		±5.0	> DN 250 ≤ DN 500
		±6.0	> DN 500 ≤ DN 800
		±7.0	> DN 800 ≤ DN 1200
		±8.0	> DN 1200 ≤ DN 1600
		±10.0	> DN 1600 ≤ DN 2000
	All other codes	±12.0	> DN 2000
		±2.0	≤ DN 150
		±3.0	> DN 150 ≤ DN 500
		±5.0	> DN 500 ≤ DN 1200
		±7.0	> DN 1200 ≤ DN 1800
		±10.0	> DN 1800
		Length through hub <i>H</i> ₁ , <i>H</i> ₂ , <i>H</i> ₃	111, 112, 113, 134
±2.0	> DN 80 ≤ DN 250		
±3.0	> DN 250		
Neck diameter <i>N</i> ₁ , <i>N</i> ₂ , <i>N</i> ₃	111, 121, 134	+0 -2.0	≤ DN 50
		+0 -4.0	> DN 50 ≤ DN 150
		+0 -6.0	> DN 150 ≤ DN 300
		+0 -8.0	> DN 300 ≤ DN 600
		+0 -10.0	> DN 600 ≤ DN 1200
	112, 113	+1.0 -0	≤ DN 50
		+2.0 -0	> DN 50 ≤ DN 150
		+4.0 -0	> DN 150 ≤ DN 300
		+8.0 -0	> DN 300 ≤ DN 600
		+12.0 -0	> DN 600 ≤ DN 1200
		+16.0 -0	> DN 1200 ≤ DN 1800
		+20.0 -0	> DN 1800

BS 4504 : Section 3.1 : 1989

Table 14 (concluded)			
Dimensions	Flange code	Tolerance	Size
Flange thickness C_1 , C_2 , C_3 , C_4	All codes (machined on both faces)	mm	
		± 1.0	≤ 18 mm thickness
		± 1.5	> 18 mm ≤ 50 mm thickness
	All codes (machined on front face only)	± 2.0	> 50 mm thickness
		$+2.0$ -1.3	≤ 18 mm thickness
		$+4.0$ -1.5	> 18 mm ≤ 50 mm thickness
		$+7.0$ -2.0	> 50 mm thickness
Facing diameter d_1	All codes	$+2.0$ -1.0	\leq DN 250
		$+3.0$ -1.0	$>$ DN 250
Facing height f_1	All codes (facing type B)	$+0$ -1.0	2 mm
		$+0$ -2.0	3 mm
		$+0$ -3.0	4 mm
		$+0$ -4.0	5 mm
		$+0$ -5.0	6 mm
Facing height f_2	All codes (facing types C and E)	$+0.5$ -0	All sizes
	(facing type G)	$+0$ -0.5	
	(facing type H)	$+0.2$ -0	
Facing height f_3	All codes (facing types D and F)	$+0$ -0.5	All sizes
Facing height f_4	All codes (facing type H)	$+0.5$ -0	All sizes
Facing	W X Y Z	All codes	All sizes
		$+0.5$ -0	
		$+0$ -0.5	
		$+0.5$ -0	
		$+0$ -0.5	
Diameter of bolt circle K	All codes	± 0.9	Bolt sizes M10 to M24
		± 1.4	Bolt sizes M27 to M45
Centre-to-centre of adjacent bolt holes	All codes	± 0.45	Bolt sizes M10 to M24
		± 0.7	Bolt sizes M27 to M45
Eccentricity of machined facing diameters	All codes	1.0	\leq DN 100
		2.0	$>$ DN 100
Parallelism between bolting bearing surfaces and flange jointing faces	All codes (machined surfaces)	1°	All sizes
	All codes (unmachined surfaces)	2°	

Table 15. Pressure/temperature ratings and bolting materials for group A ferritic steel flanges															
(a) Pressure/temperature ratings															
PN	Material group	Temperature													
		Up to 120 °C	150 °C	200 °C	250 °C	300 °C	350 °C	400 °C	425 °C	450 °C	475 °C	500 °C	510 °C	520 °C	530 °C
		Maximum non-shock working gauge pressure													
2.5	A1	bar*	bar	bar	bar	bar	bar	bar	bar	bar	bar	bar	bar	bar	
	A2	2.5	2.3	2.0	1.8	1.5	—	—	—	—	—	—	—	—	
	A3	2.5	2.5	2.5	2.0	1.8	1.4	1.2	—	—	—	—	—	—	
6	A1	6.0	5.4	4.8	4.2	3.6	—	—	—	—	—	—	—	—	
	A2	6.0	5.4	4.8	4.2	3.6	3.0	2.1	—	—	—	—	—	—	
	A3	6.0	5.9	5.7	5.4	4.8	4.2	3.3	2.7	—	—	—	—	—	
10	A1	10.0	9.0	8.0	7.0	6.0	—	—	—	—	—	—	—	—	
	A2	10.0	9.0	8.0	7.0	6.0	5.0	3.5	—	—	—	—	—	—	
	A3	10.0	9.8	9.5	9.0	8.0	7.0	5.5	4.5	—	—	—	—	—	
	A4	10.0	10.0	10.0	10.0	8.7	7.8	7.4	7.2	7.0	—	—	—	—	
16	A1	16.0	14.4	12.8	11.2	9.6	—	—	—	—	—	—	—	—	
	A2	16.0	14.4	12.8	11.2	9.6	8.0	5.6	—	—	—	—	—	—	
	A3	16.0	15.7	15.2	14.4	12.8	11.2	8.8	7.2	—	—	—	—	—	
	A4	16.0	16.0	16.0	16.0	13.9	12.5	11.8	11.5	11.2	—	—	—	—	
	A5	16.0	16.0	16.0	16.0	16.0	15.2	14.6	14.2	13.9	13.1	11.8	9.9	7.8	6.1
25	A1	25.0	22.5	20.0	17.5	15.0	—	—	—	—	—	—	—	—	
	A2	25.0	22.5	20.0	17.5	15.0	12.5	8.8	—	—	—	—	—	—	
	A3	25.0	24.5	23.8	22.5	20.0	17.5	13.8	11.3	—	—	—	—	—	
	A4	25.0	25.0	25.0	25.0	21.8	19.5	18.5	18.0	17.5	—	—	—	—	
	A5	25.0	25.0	25.0	25.0	25.0	23.8	22.8	22.3	21.8	20.5	18.5	15.5	12.3	9.5
	A6	25.0	25.0	25.0	25.0	25.0	25.0	22.8	22.3	21.8	20.0	13.8	12.5	11.0	9.5
40	A1	40.0	36.0	32.0	28.0	24.0	—	—	—	—	—	—	—	—	
	A2	40.0	36.0	32.0	28.0	24.0	20.0	14.0	—	—	—	—	—	—	
	A3	40.0	39.0	38.0	36.0	32.0	28.0	22.0	18.0	—	—	—	—	—	
	A4	40.0	40.0	40.0	40.0	34.8	31.2	29.6	28.8	28.0	—	—	—	—	
	A5	40.0	40.0	40.0	40.0	40.0	38.0	36.4	35.6	34.8	32.8	29.6	24.8	19.6	15.2
	A6	40.0	40.0	40.0	40.0	40.0	40.0	36.4	35.6	34.8	32.0	22.0	20.0	17.6	15.2

*1 bar = 10⁵ N/m² = 10⁵ Pa.

(b) Materials for bolting			
British Standard	Grade/product	For use with flange material groups	Limiting temperature °C
BS 4190	4.6 bolts 4 nuts	A1, A2 and A3	For use at temperatures not exceeding 300 °C
BS 3692	4.6 bolts 4 nuts		
BS 3692	8.8 bolts 8 nuts	A3, A4, A5 and A6	
BS 4882	B7M, B7AM, B16M Stud bolts 2HM, 4M nuts	A3, A4, A5 and A6	For use at temperatures up to 530 °C

NOTE. For bolting also see clause 6.

BS 4504 : Section 3.1 : 1989

Table 16. Pressure/temperature ratings for group B austenitic steel flanges on a basis of 0.2 % proof stress											
PN	Material group	Temperature									
		Up to 50 °C	100 °C	150 °C	200 °C	250 °C	300 °C	350 °C	400 °C	450 °C	500 °C
Maximum non-shock working gauge pressure											
		bar	bar	bar	bar	bar	bar	bar	bar	bar	bar
2.5	B1	2.2	1.8	1.6	1.5	1.4	1.3	1.2	1.1	1.1	1.0
	B2	2.3	1.9	1.8	1.6	1.5	1.4	1.3	1.2	1.2	1.2
	B3	2.4	2.2	2.1	1.9	1.8	1.7	1.6	1.6	1.5	1.5
	B4	2.4	2.1	1.9	1.7	1.6	1.5	1.4	1.4	1.3	1.3
	B5	2.5	2.2	2.0	1.8	1.7	1.6	1.5	1.4	1.4	1.4
6	B1	5.1	4.2	3.8	3.5	3.2	2.9	2.8	2.6	2.5	2.4
	B2	5.4	4.5	4.1	3.7	3.5	3.2	3.0	2.9	2.8	2.7
	B3	5.7	5.2	4.8	4.5	4.2	4.0	3.8	3.7	3.5	3.5
	B4	5.7	4.8	4.4	4.0	3.7	3.5	3.3	3.2	3.0	2.9
	B5	6.0	5.1	4.6	4.2	4.0	3.7	3.5	3.4	3.3	3.2
10	B1	8.5	7.1	6.3	5.8	5.3	4.9	4.6	4.3	4.2	4.0
	B2	9.0	7.6	6.8	6.2	5.8	5.4	5.1	4.8	4.6	4.5
	B3	9.5	8.6	8.1	7.6	7.1	6.6	6.3	6.1	5.9	5.8
	B4	9.5	8.1	7.3	6.7	6.2	5.8	5.5	5.3	5.0	4.9
	B5	10.0	8.5	7.7	7.1	6.6	6.2	5.9	5.6	5.5	5.4
16	B1	13.7	11.3	10.1	9.2	8.4	7.8	7.3	6.9	6.6	6.3
	B2	14.4	12.1	10.9	9.9	9.2	8.6	8.1	7.7	7.4	7.2
	B3	15.2	13.7	12.9	12.1	11.3	10.6	10.1	9.8	9.4	9.3
	B4	15.2	12.9	11.7	10.7	9.9	9.3	8.8	8.4	8.0	7.8
	B5	16.0	13.7	12.3	11.3	10.5	9.9	9.4	9.0	8.7	8.6
25	B1	21.4	17.7	15.9	14.4	13.2	12.2	11.5	10.9	10.4	9.9
	B2	22.6	18.9	17.1	15.5	14.4	13.4	12.7	12.0	11.6	11.2
	B3	23.8	21.5	20.1	18.9	17.7	16.6	15.9	15.3	14.8	14.5
	B4	23.8	20.1	18.3	16.7	15.5	14.5	13.8	13.2	12.6	12.2
	B5	25.0	21.4	19.3	17.7	16.5	15.5	14.6	14.0	13.7	13.4
40	B1	34.2	28.3	25.4	23.0	21.1	19.5	18.4	17.4	16.6	15.8
	B2	36.1	30.2	27.3	24.8	23.0	21.5	20.3	19.1	18.5	18.0
	B3	38.0	34.4	32.2	30.2	28.3	26.5	25.4	24.4	23.6	23.2
	B4	38.0	32.2	29.3	26.7	24.8	23.2	22.0	21.1	20.1	19.5
	B5	40.0	34.2	30.8	28.3	26.4	24.8	23.4	22.4	21.8	21.5

NOTE. The selection of bolting materials for use with austenitic steel flanges is the responsibility of the user and reference should be made to BS 4882.


Table 17. Pressure/temperature ratings for group C nickel steel flanges		
PN	Material group	Temperature
		Up to 120 °C
		Maximum non-shock working gauge pressure
2.5	C1	bar 2.5
	C2	2.5
6	C1	6.0
	C2	6.0
10	C1	10.0
	C2	10.0
16	C1	16.0
	C2	16.0
25	C1	25.0
	C2	25.0
40	C1	40.0
	C2	40.0

NOTE. The selection of bolting materials for use with nickel steel flanges is the responsibility of the user and reference should be made to BS 4882.

BS 4504 : Section 3.1 : 1989

Table 18. Minimum hub radius after back facing

Flange size	R_{min}
	mm
Up to and including DN 50	2
Over DN 50 and up to and including DN 200	3
Over DN 200	5

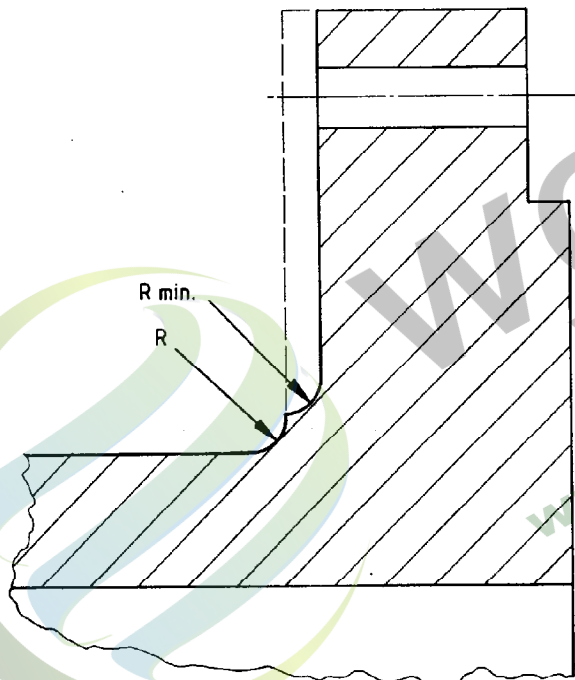

NOTE. For dimensions of R see tables 8 to 13.

Figure 11. Minimum hub radius after back facing

Appendices

Appendix A. Information to be supplied by purchaser

The following information should be supplied by the purchaser in his enquiry and/or order.

- (a) Number and Section of this British Standard, i.e. BS 4504 : Section 3.1.
- (b) Nominal size: DN followed by the appropriate number (see clause 3).
- (c) Nominal pressure: PN followed by the appropriate number (see clause 4).
- (d) Flange type by code number or description (see clause 1)*.
- (e) Facing type letter (see figure 3).
- (f) Material and if any heat treatment is required (see 5.2.1).
- (g) Whether bolting, made using free cutting steel, can be supplied (see 6.1).
- (h) Weld end preparation required (see note 3 to 8.1).
- (j) Internal thread designation if other than BS 21 parallel thread form (see 8.3.1).
- (k) External diameter and thickness of pipe (see notes to tables of flange dimensions).
- (l) Material certificate, if required (see 5.1).
- (m) Details of special coatings, if required (see 9.3.1).
- (n) Dimension *S* where appropriate (see tables 8 to 13).
- (p) Bore diameter *B* when appropriate (i.e. above DN 600) (see notes to tables of flange dimensions following table 13).
- (q) The bore for weld-neck (code 111) and hubbed slip-on (code 112) flanges, if different from those specified in this standard (see notes to tables of flange dimensions).

Appendix B. Application and installation

NOTE. The information in this appendix is advisory only and it is not intended to be exhaustive.

B.1 In applying the ratings to flanged joints the effects of the following should be considered.

- (a) The risk of leakage due to forces and moments developed in the connecting pipework.
- (b) At temperatures in the creep range gradual relaxation of flanged joints due to creep in the bolts may progressively reduce bolt loads.
- (c) At low temperatures some of the materials listed in the rating tables undergo a sufficient decrease in impact resistance such that they cannot safely sustain sudden changes of stress or temperature.
- (d) Due to the nature of any thread sealant used additional limitations may be placed on the range of application of a threaded flange.

B.2 When the type B raised face is removed from a steel flange which is to be bolted to a flat face cast iron or copper alloy flange in order to provide full face gasketing if such is required this will reduce the pressure/temperature rating to that of the mating cast iron or copper alloy flange.

B.3 The pressure/temperature ratings specified may also be applied to installations subject to moderate shock such as may occur in well designed and efficiently operated boiler feed mains. When a system may be subject to severe shock the purchaser should make a suitable allowance when stating the design pressure.


B.4 Where there is an appropriate application standard, the purchaser should ensure that the materials comply with the requirements of that standard. Attention is drawn to BS 759 and BS 806.

B.5 Flanges may be required to be tested after attachment of a pipe or other equipment or when forming an integral part of such equipment. The test pressure is then dependent on the requirements of the appropriate standard or code of practice in accordance with which the equipment has been fabricated or manufactured. Any test pressure should not exceed 1.5 times the maximum permissible working pressure at 20 °C rounded off to the next higher 1 bar increment.

*Reference should be given to ancillary component for flanges where appropriate.

Appendix C. Weld-end preparations

Typical weld-end preparations are given in figure 12.

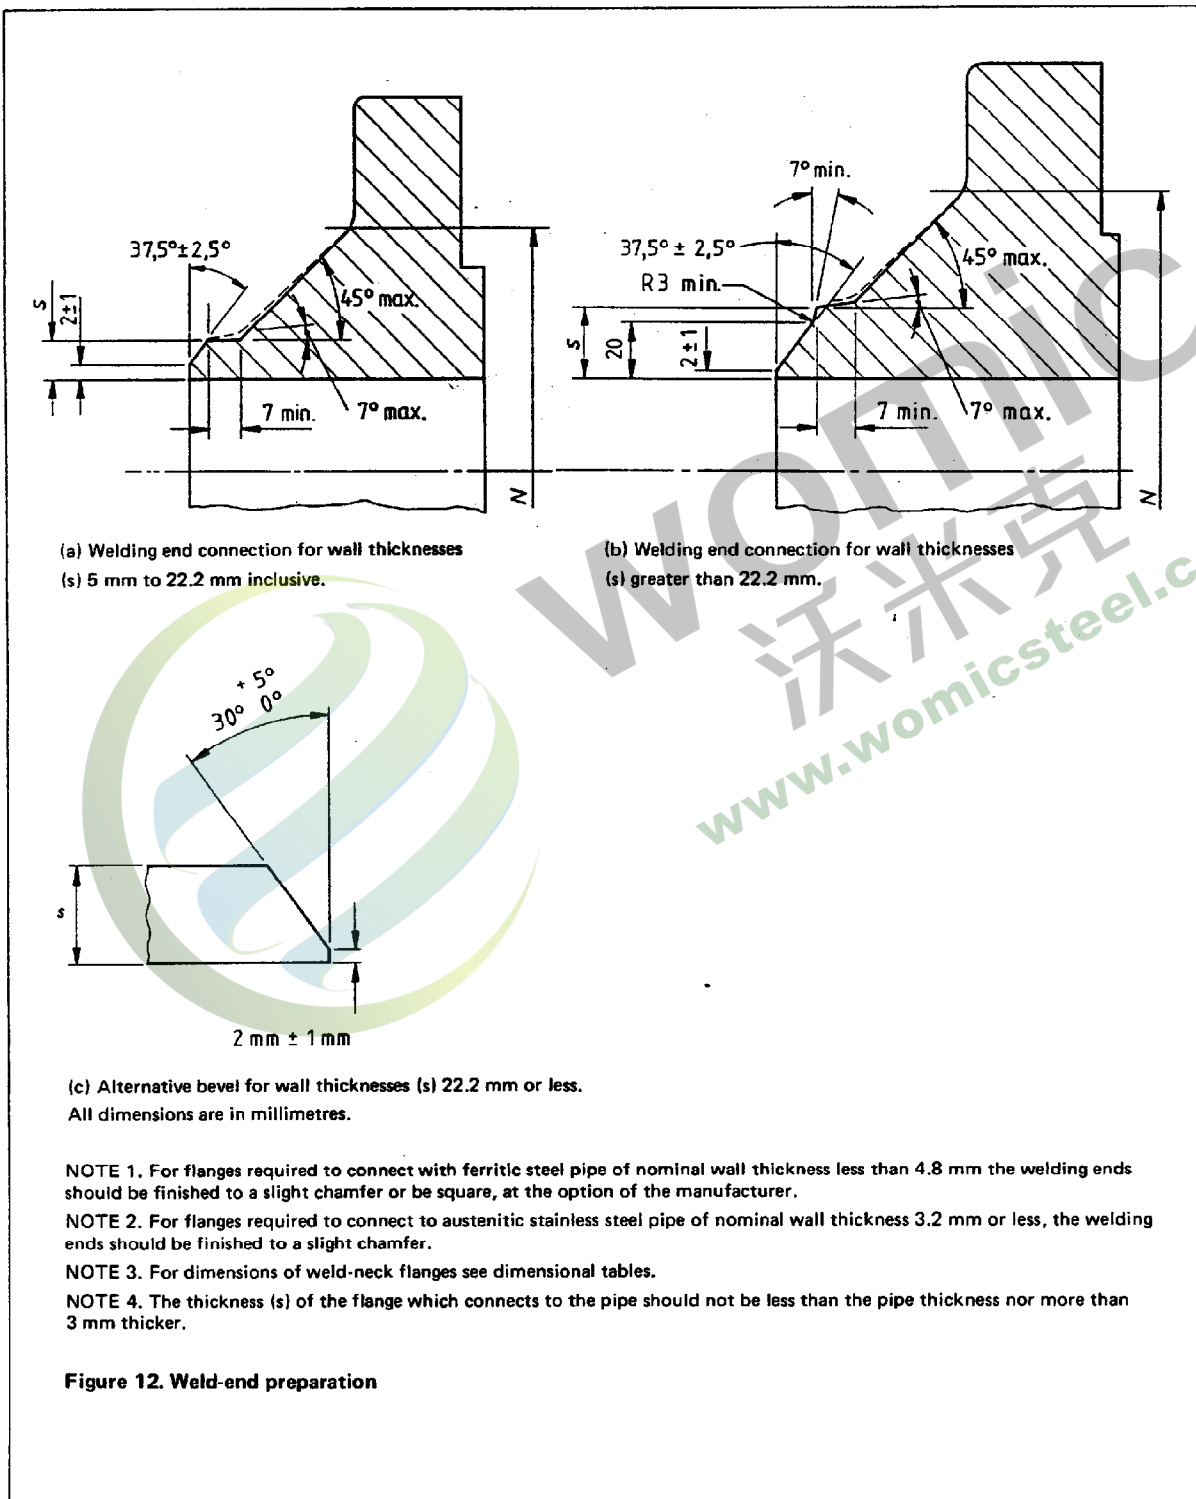

Appendix D. Comparison of steel flange descriptions and code numbers specified in BS 4504 : Section 3.1 : 1989 and BS 4504 : Part 1 : 1969

Table 19. Steel flange descriptions and code numbers specified in BS 4504 : Section 3.1 : 1989 and BS 4504 : Part 1 : 1969		
Description of flange type	Code number in BS 4504 : Part 3 : Section 3.1 : 1989	Type number superseded in BS 4504 : Part 1 : 1969
Plate flange for welding	101	3
Loose plate flange with weld-on plate collar	102 and 132	—
Loose plate flange with weld-on plate collar for lapped pipe end	102 and 133	6
Loose plate flange with weld-neck collar	104 and 134	—
Blank flange	105	8
Weld-neck flange	111	2
Hubbed slip-on flange for welding	112	5
Hubbed threaded flange	113	4
Integral	121	1

Publications referred to

BS 21	Specification for pipe threads for tubes and fittings where pressure-tight joints are made on the threads (metric dimensions)
BS 759	Valves, gauges and other safety fittings for application to boilers and to piping installations for and in connection with boilers
BS 806	Specification for design and construction of ferrous piping installations for and in connection with land boilers
BS 970	Specification for wrought steels for mechanical and allied engineering purposes Part 1 General inspection and testing procedures and specific requirements for carbon, carbon manganese, alloy and stainless steels
BS 1134	Method for the assessment of surface texture
BS 1501	Steels for fired and unfired pressure vessels: plates Part 1 Specification for carbon and carbon manganese steels Part 2 Specification for alloy steels Part 3 Corrosion and heat resisting steels. Imperial units
BS 1503	Specification for steel forgings (including semi-finished forged products) for pressure purposes
BS 1504	Specification for steel castings for pressure purposes
BS 1560*	Circular flanges for pipes, valves and fittings (Class designated) Part 3 Steel, cast iron and copper alloy flanges Section 3.1 Specification for steel flanges
BS 2633	Specification for Class 1 arc welding of ferritic steel pipework for carrying fluids
BS 3600	Specification for dimensions and masses per unit length of welded and seamless steel pipes and tubes for pressure purposes
BS 3692	Specification for ISO metric precision hexagon bolts, screws and nuts. Metric units
BS 3920	Derivation and verification of elevated temperature properties for steel products for pressure purposes
BS 4190	Specification for ISO metric black hexagon bolts, screws and nuts
BS 4320	Specification for metal washers for general engineering purposes. Metric series
BS 4360	Specification for weldable structural steels
BS 4439	Specification for screwed studs for general purposes. Metric series
BS 4570	Specification for fusion welding of steel castings
BS 4865	Dimensions of gaskets for flanges to BS 4504 Part 1 Specification for non-metallic flat gaskets Part 2 Specification for metallic spiral-wound gaskets for use with steel flanges Part 3 Specification for non-metallic envelope gaskets Part 4 Specification for corrugated, flat or grooved metallic and filled metallic gaskets for use with steel flanges
BS 4882	Specification for bolting for flanges and pressure containing purposes
BS 5135	Specification for process of arc welding of carbon and carbon manganese steels
BS 5500	Specification for unfired fusion welded pressure vessels
BS 5750*	Quality systems
BS 6920	Suitability of non-metallic products for use in contact with water intended for human consumption with regard to their effect on the quality of the water Part 1 Specification
ISO 4200	Plain end steel tubes, welded and seamless — General tables of dimensions and masses per unit length
ISO 6708	Pipe components — Definition of nominal size
ISO 7005	Metallic flanges Part 3 Copper alloy and composite flanges
ISO 7268	Pipe components — Definition of nominal pressure
ANSI/ASME B1.20.1	Pipe threads, general purpose (inch)
ASTM A105	Specification for forgings, carbon steel, for piping components
ASTM A181	Specification for forgings, carbon steel, for general-purpose piping
ASTM A182	Specification for forged or rolled alloy-steel pipe flanges, forged fittings, and valves and parts for high-temperature service
ASTM A203	Specification for pressure vessel plates, alloy steel, nickel
ASTM A204	Pressure vessel plates, alloy steel, molybdenum
ASTM A216	Specification for carbon-steel castings suitable for fusion welding for high-temperature service
ASTM A217	Specification for martensitic stainless steel and alloy steel castings for pressure-containing parts suitable for high-temperature service
ASTM A240	Heat resisting chromium and chromium-nickel stainless steel plate, sheet, and strip pressure vessels
ASTM A283	Specification for low and intermediate tensile strength carbon steel plates, shapes and bars
ASTM A350	Specification for forgings, carbon and low alloy steel, requiring notch toughness testing for piping components
ASTM A351	Specification for austenitic steel castings for high-temperature service
ASTM A352	Specification for ferritic and martensitic steel castings for pressure-containing parts suitable for low-temperature service
ASTM A363	Specification for pressure vessel plates, alloy steel 9 % nickel, double-normalized and tempered
ASTM A387	Specification for pressure vessel plates, chromium-molybdenum alloy steel
ASTM A515	Specification for pressure vessel plates, carbon steel, for intermediate and higher-temperature service
ASTM A516	Specification for pressure vessel plates, carbon steel, for moderate and lower-temperature service
ASTM A522	Specification for forged or rolled 8 % and 9 % nickel alloy steel flanges, fittings, valves and parts for low-temperature service
ASTM A553	Pressure vessel plates, alloy steel, quenched and tempered 8 and 9 percent nickel
DIN 17100	Steels for general structural purposes; quality standard
DIN 17243	Weldable steels for elevated temperatures in the form of forgings or hot rolled or forged bars; Technical delivery conditions

*Referred to in the foreword only.

BS 4504 : Section 3.1 : 1989

This British Standard, having been prepared under the direction of the Piping Systems Components Standards Policy Committee, was published under the authority of the Board of BSI and comes into effect on 30 June 1989

© British Standards Institution, 1989

ISBN 0 580 17037 3

The following BSI references relate to the work on this standard:
Committee reference PSE/15 Draft for comment 85/78242 DC

British Standards Institution. Incorporated by Royal Charter, BSI is the independent national body for the preparation of British Standards. It is the UK member of the International Organization for Standardization and UK sponsor of the British National Committee of the International Electrotechnical Commission.

In addition to the preparation and promulgation of standards, BSI offers specialist services including the provision of information through the BSI Library and Standardline Database; Technical Help to Exporters; and other services. Advice can be obtained from the Enquiry Section, BSI, Milton Keynes MK14 6LE, telephone 0908 221166, telex 825777.

Copyright. Users of British Standards are reminded that copyright subsists in all BSI publications. No part of this publication may be reproduced in any form without the prior permission in writing of BSI. This does not preclude the free use, in the course of

implementing the standard, of necessary details such as symbols and size, type or grade designations. Enquiries should be addressed to the Publications Manager, BSI, Linford Wood, Milton Keynes MK14 6LE. The number for telephone enquiries is 0908 220022 and for telex 825777.

Contract requirements. A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Revision of British Standards. British Standards are revised, when necessary, by the issue either of amendments or of revised editions. It is important that users of British Standards should ascertain that they are in possession of the latest amendments or editions.

Automatic updating service. BSI provides an economic, individual and automatic standards updating service called PLUS. Details are available from BSI Enquiry Section at Milton Keynes, telephone 0908 221166, telex 825777.

Information on all BSI publications is in the *BSI Catalogue*, supplemented each month by *BSI News* which is available to subscribing members of BSI and gives details of new publications, revisions, amendments and withdrawn standards. Any person who, when making use of a British Standard, encounters an inaccuracy or ambiguity, is requested to notify BSI without delay in order that the matter may be investigated and appropriate action taken.

Committees responsible for this British Standard

The preparation of this British Standard was entrusted by the Piping Systems Components Standards Policy Committee (PSE/-) to Technical Committee PSE/15, upon which the following bodies were represented:

British Chemical Engineering Contractors' Association
British Compressed Gases Association
British Fluid Power Association
British Foundry Association
British Gas plc
British Malleable Tube Fittings Association
British Maritime Technology
British Non-ferrous Metals Federation
British Pump Manufacturers' Association
British Steel Industry
British Valve and Actuator Manufacturers' Association Ltd.

Combustion Engineering Association
Copper Development Association
Department of Trade and Industry (National Engineering Laboratory)
Ductile Iron Producers' Association
Electricity Supply Industry in England and Wales
Energy Industries Council
Engineering Equipment and Materials Users' Association
GAMBICA (BEAMA Ltd.)
High Pressure Pipework Consultative Committee
Institution of Gas Engineers
Institution of Mechanical Engineers
Institution of Production Engineers
Institution of Water and Environmental Management (IWEM)
Water Authorities Association

Amendments issued since publication

Amd. No.	Date of issue	
7555	21.6.93	B-Bids

British Standards Institution · 2 Park Street London W1A 2BS · Telephone 071-629 9000 · Telex 266933



Amendment No. 1
published and effective from 28 September 1990
to BS 4504 : Section 3.1 : 1989

Valves and fittings (PN designated)
Part 3. Steel, cast iron and copper alloy flanges
Section 3.1 Specification for steel flanges

Revised text

AMD 6610
September 1990

Clause 5.2.1 General

Delete '(a) For materials to ASTM 105' and substitute '(a) For materials to ASTM A105'.

Delete '(b) For materials to ASTM 182' and substitute '(b) For materials to ASTM A182'.

AMD 6610
September 1990

Table 3. Materials: ferritic steels (group A)*

In row 2 'Low grade carbon steel' of column 3 'Plates, Other Standards†', beneath 'ASTM A283 Grade C' insert 'DIN 17100 + R.St 37.2'

In row 5 'Carbon molybdenum steel' of column 2 'Plates, British Standard' delete 'BS 1501 : Part 1-240 §' and substitute 'BS 1501 : Part 1-243 §'.

In row 7 of column 1, 'Materials' delete '1½ % chromium ½ % molybdenum steel' and substitute '1¼ % chromium ½ % molybdenum steel'.

In row 8 of column 1, 'Materials' delete '2¼ % chromium 1 % molybdenum steel' and substitute '2¼ % chromium 1 % molybdenum steel'.

Delete all of footnote § and substitute '§BS 1501-243 material is not suitable for use above 400 °C.'

AMD 6610
September 1990

Table 4. Materials: austenitic steels (group B)*

In row 5 'Austenitic chromium-nickel-molybdenum (low carbon) steel' of column 2 'Plates, British Standard' delete

'BS 1501 : Part 3-312S12' and 'BS 1501 : Part 3-312S49' and substitute 'BS 1501 : Part 3-321S12' and 'BS 1501 : Part 3-321S49' respectively.

AMD 6610
September 1990

Table 7. Dimensions of flange faces

Delete the entire table and substitute the new table 7 attached.

AMD 6610
September 1990

Table 8. Dimensions of PN 2.5 flanges

Against nominal size DN 700, in column C₂ delete '26' and substitute '24'.

AMD 6610
September 1990

Table 9. Dimensions of PN 6 flanges

Against the nominal sizes shown below delete the dimensions in the column headed C_4 and substitute the following:

DN	C_4
350	22
400	22
450	24
500	24
600	34
700	38
800	42
900	46

AMD 6610
September 1990

Table 13. Dimensions of PN 40 flanges

Against nominal size DN 200, in the column headed C_4 delete '36' and substitute '34'.



Womic
沃米克
www.womicsteel.com



Amendment No. 2
published and effective from 31 January 1991
to BS 4504 : Section 3.1 : 1989

**Circular flanges for pipes, valves
and fittings (PN designated)**
Part 3. Steel, cast iron and copper alloy flanges
Section 3.1 Specification for steel flanges

NOTE. Amendment No. 1 to BS 4504 : Section 3.1 : 1989 included an incorrect instruction when amending table 4. To avoid any confusion, this amendment reproduces table 4 in full.

Correction

AMD 6334
January 1991

Table 4. Materials: austenitic steels (group B) (as amended by Amendment No. 1)

Delete the existing table and substitute the new table 4 attached.



WOMIC
沃米克
www.womicsteel.com

Table 4. Materials: austenitic steels (group B)*										
Materials	Plates			Forgings			Castings			Group No.†
	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†	British Standard	Comparable ASTM standard†		
Austenitic chromium-nickel (low carbon) steel	BS 1501: Part 3 - 304S12	ASTM A240 - 304L	BS 1503 - 304S11	ASTM A182 Grade F304L	BS 1504 - 304C12	ASTM A351 Grade CF3			B1	
Austenitic chromium-nickel steel	BS 1501: Part 3 - 304S15	ASTM A240 - 304 ASTM A240 - 304H	BS 1503 - 304S31 BS 1503 - 304S51	ASTM A182 Grade F304 ASTM A182 Grade F304H	BS 1504 - 304C15	ASTM A351 Grade CF8			B2	
Austenitic chromium-nickel (nitrogen stabilised) steel	BS 1501: Part 3 - 347S17 BS 1501: Part 3 - 347S49	ASTM A240 - 347 ASTM A240 - 347H	BS 1503 - 347S31 BS 1503 - 347S51	ASTM A182 Grade F347 ASTM A182 Grade F347H	BS 1504 - 347C17	ASTM A351 Grade CF8C			B3	
Austenitic chromium-nickel (titanium stabilised) steel	BS 1501: Part 3 - 321S12 BS 1501: Part 3 - 321S49	ASTM A240 - 321 ASTM A240 - 321H	BS 1503 - 321S31 BS 1503 - 321S51	ASTM A182 Grade F321 ASTM A182 Grade F321H	—	—			B3	
Austenitic chromium-nickel-molybdenum (low carbon) steel	BS 1501: Part 3 - 316S12	ASTM A240 - 316L	BS 1503 - 316S11	ASTM A182 Grade F316L	BS 1504 - 316C12	ASTM A351 Grade CF3M			B4	
Austenitic chromium-nickel-molybdenum steel	BS 1501: Part 3 - 316S16	ASTM A240 - 316 ASTM A240 - 316H	BS 1503 - 316S31 BS 1503 - 316S51	ASTM A182 Grade F316 ASTM A182 Grade F316H	BS 1504 - 316C16	ASTM A351 Grade CF8M			B5	
Austenitic 25 % chromium - 20 % nickel steel	BS 1501: Part 3 - 310S24	ASTM A240 - 310S	BS 1503 - 310S31	ASTM A182 Grade F310	BS 1504 - 310C40	ASTM A351 Grade HK40 ASTM A351 Grade CK20			B5	

*Group numbers relate to the pressure/temperature ratings given in table 16.

†Refer to BS 1560: Section 3.1 or ASTM specifications for limitations or recommendations in respect to ASTM materials.

NOTE. Where materials are used below 0 °C refer to the application code.



AMD 7555

Amendment No. 3

published and effective from 15 June 1993
to BS 4504 : Section 3.1 : 1989

Circular flanges for pipes, valves and fittings
(PN designated)

Part 3. Steel, cast iron and copper alloy flanges
Section 3.1 Specification for steel flanges

Revised text

AMD 7555
June 1993

Table 7. Dimensions of flange faces (as amended by Amendment No. 1)

Delete the existing table and substitute the new table 7 attached.

AMD 7555
June 1993

Figure 5. Dimensions of PN 2.5 flanges

Delete the existing figure and substitute the new figure 5 attached.

AMD 7555
June 1993

Figure 6. Dimensions of PN 6 flanges

Delete the existing figure and substitute the new figure 6 attached.

AMD 7555
June 1993

Table 9. Dimensions of PN 6 flanges (as amended by Amendment No. 1)

In the column of flange thicknesses C_2 and C_3 for code 111, 112, 113 and 121 flanges, delete '22' and substitute '24' in the row for DN 450.

AMD 7555
June 1993

Figure 7. Dimensions of PN 10 flanges

Delete the existing figure and substitute the new figure 7 attached.

AMD 7555
June 1993

Figure 8. Dimensions of PN 16 flanges

Delete the existing figure and substitute the new figure 8 attached.

AMD 7555
June 1993

Table 11. Dimensions of PN 16 flanges

In the column of flange thickness C_4 for code 105 flanges, delete '36' and substitute '34' in the row for DN 450.

AMD 7555
June 1993

Figure 9. Dimensions of PN 25 flanges

Delete the existing figure and substitute the new figure 9 attached.

AMD 7555
June 1993

Table 12. Dimensions of PN 25 flanges

In the column of flange thickness C_4 for code 105 flanges, delete '44' and substitute '42' in the row for DN 450.

AMD 7555
June 1993

Figure 10. Dimensions of PN 40 flanges


Delete the existing figure and substitute the new figure 10 attached.



Womic
沃米克
www.womicsteel.com

Table 7. Dimensions of flange faces

Nominal size DN	d ₁					f ₁	f ₂	f ₃	f ₄	w	x	y	z	α	d ₂
	PN 2.5	PN 6	PN 10	PN 16	PN 25										
10	35	35	40	40	40	2				24	34	35	23		5
15	40	40	45	45	45	2			29	39	40	28			
20	50	50	58	58	58					36	50	51	35		
25	60	60	68	68	68	4			43	57	58	42			
32	70	70	78	78	78					51	65	66	50		
40	80	80	88	88	88	3			61	75	76	60			
50	90	90	102	102	102					73	87	88	72		
65	110	110	122	122	122	3			95	109	110	94			
80	128	128	138	138	138					106	120	121	105		
100	148	148	162	162	162	3			129	149	150	128			
125	178	178	188	188	188					155	175	176	154		
150	202	202	212	212	212	4.5			183	203	204	182			
200	258	258	268	268	268					239	259	260	238		
250	312	312	320	320	320	4.5			292	312	313	291			
300	365	365	370	378	395					343	363	364	342		
350	415	415	430	438	450	4			395	421	422	394			
400	465	465	482	490	505					447	473	474	446		
450	520	520	532	550	555	4			497	523	524	496			
500	570	570	585	610	615					549	575	576	548		
600	670	670	685	725	720	5			649	675	676	648			
700	775	775	800	795	820					751	777	778	750		
800	880	880	905	900	930	5			856	882	883	855			
900	980	980	1005	1000	1030					961	987	988	960		
1000	1080	1080	1110	1115	1140	5			1062	1092	1094	1060			
1200	1280	1285	1330	1330	1350					1262	1292	1294	1260		
1400	1480	1510	1535	1530	1560	6			1482	1492	1494	1460			
1600	1690	1710	1760	1750	1780					1662	1692	1694	1660		
1800	1890	1920	1960	1950	1985	6			1882	1982	1984	1860			
2000	2090	2125	2170	2150	2210					2062	2092	2094	2060		
2200	2295	2335	2370	2370	2410	6									
2400	2495	2545	2570	2570	2610										
2600	2695	2750	2780	2780	2820	6									
2800	2910	2960	3000	3000	3040										
3000	3110	3160	3210	3210	3250	6									
3200	3310	3370	3420	3420	3460										
3400	3510	3580	3630	3630	3670	6									
3600	3720	3790	3840	3840	3880										
3800	3920	3990	4040	4040	4080	6									
4000	4120	4190	4240	4240	4280										

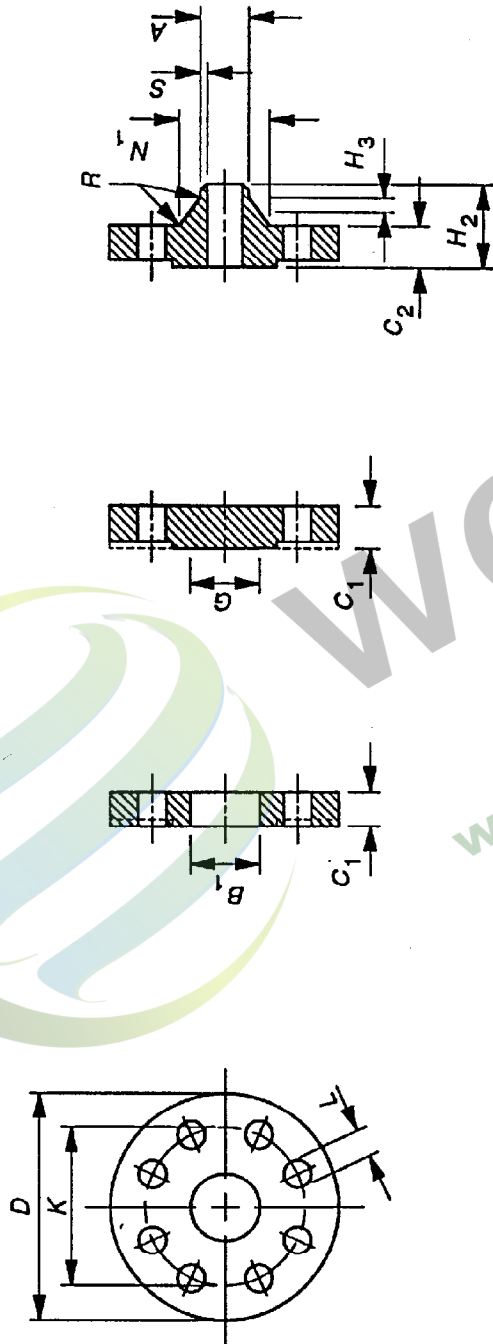

Code 111

Code 105

Code 101


This diagram illustrates the arrangement but not necessarily the correct number of bolt holes.

Refer to the column 'Bolting Number' in table 8 for actual number.

NOTE 1. Dimension N_1 is measured at the intersection of the projections of the hub draft angle and the back face of the flange.

NOTE 2. Diameter of shoulder G refers to an unmachined centre portion of the flange (see note 4 to 8.1).

Figure 5. Dimensions of PN 2.5 flanges (See table 8).

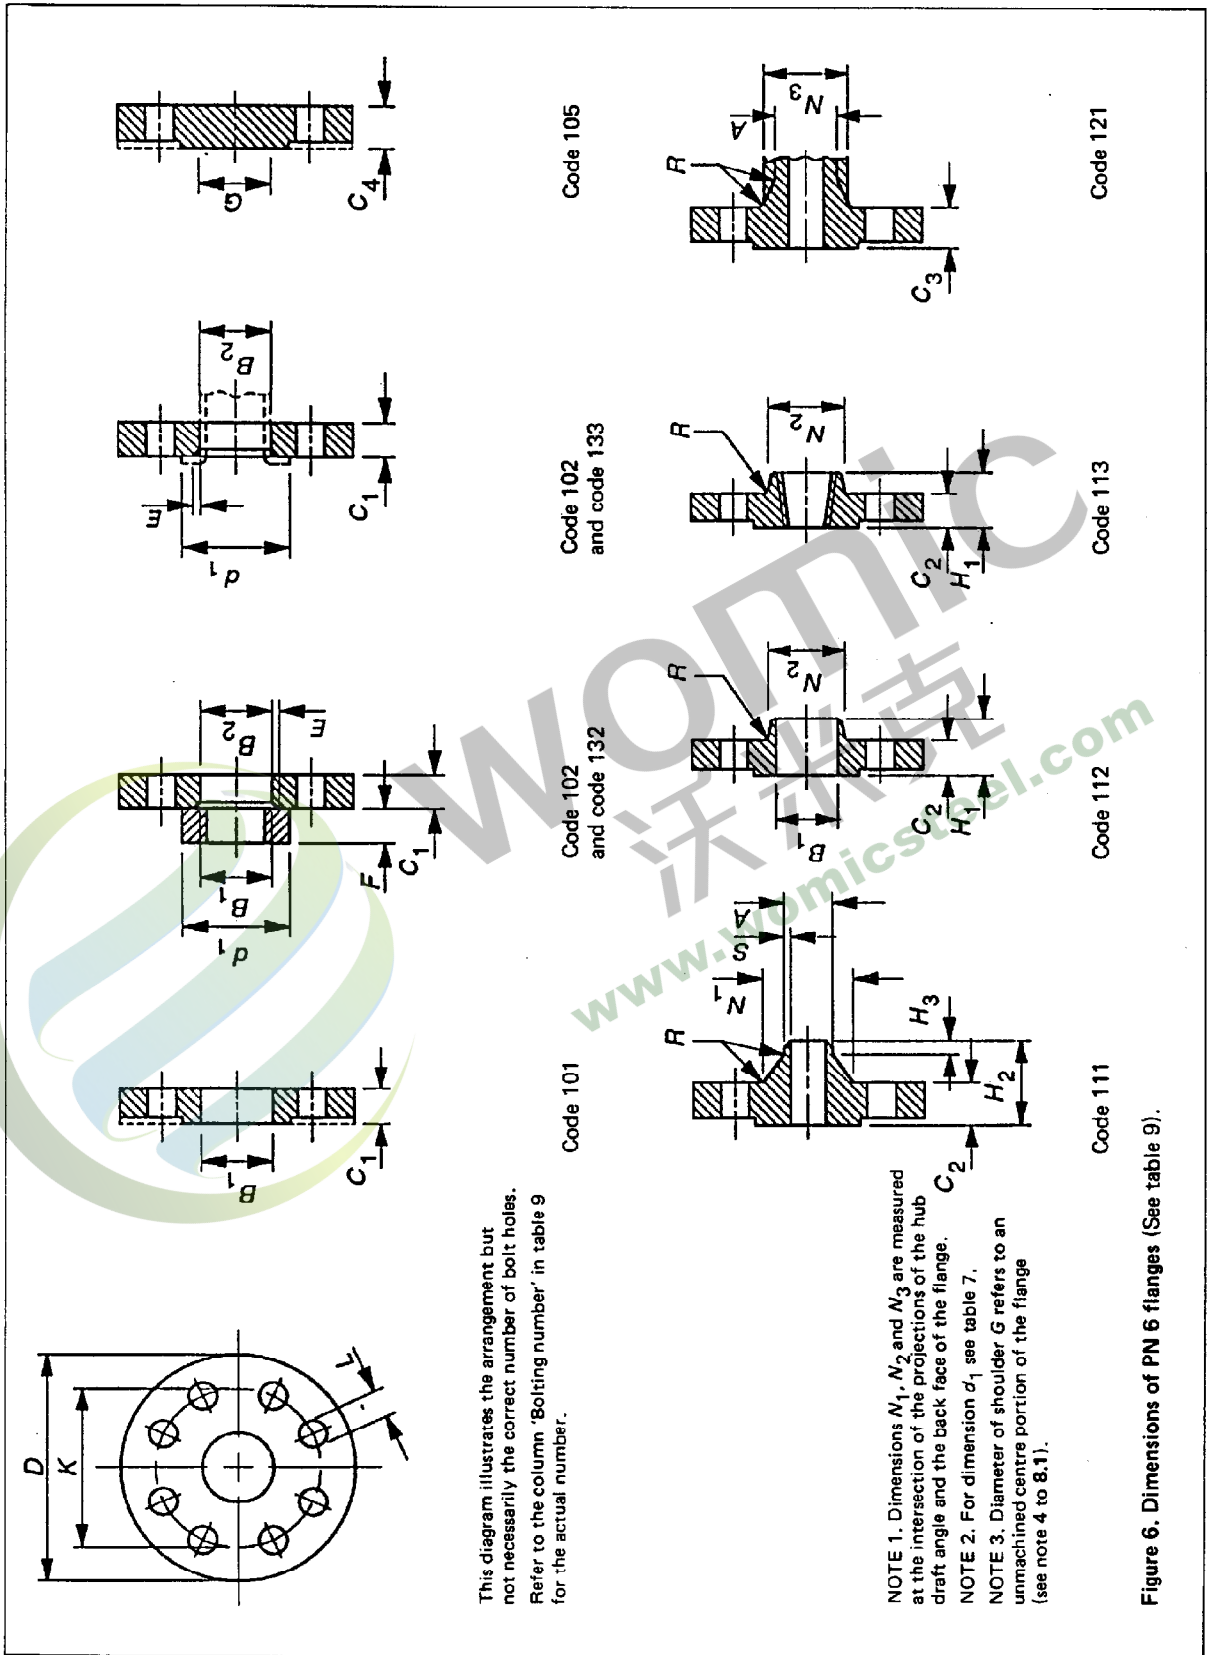

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes. Refer to the column 'Bolting number' in table 9 for the actual number.

NOTE 1. Dimensions N_1 , N_2 and N_3 are measured at the intersection of the projections of the hub draft angle and the back face of the flange.
 NOTE 2. For dimension d_1 see table 7.
 NOTE 3. Diameter of shoulder G refers to an unmachined centre portion of the flange (see note 4 to 8.1).

Figure 6. Dimensions of PN 6 flanges (See table 9).

